

Floyd County Annex Renovation

for

Floyd County, Indiana

Addendum No. 02

OWNER'S TECHNICAL REP



Envoy, Inc.

8990 E 116th St Suite 250
Fishers, Indiana 46308
Phone: 317.594.4600
Fax: 317.594.4601
www.envoycompanies.com

ARCHITECT / ENGINEER

LMH Architecture + MAR Architects
319 Bank Street
New Albany, Indiana 47150
Phone: 812-945-2324
www.lmharchitecture.com

July, 08, 2025

Project: Floyd County Annex Renovation
Date: July 08, 2025
By: Envoy, Inc.

ADDENDUM

Number: 01

This addendum is based in accordance with the provisions of "The General Conditions of the Contract for Construction," Article 1, "Contract Documents" and becomes a part of the Contract Documents as provided therein. Bids will be received at the Floyd County in the Commissioner's Office located at 2524 Corydon Pike, Suite 104, New Albany, IN 47150 until **6:00 p.m.** (local time) on **Tuesday July 15, 2025.**

Included with this Addendum are the following Notes and Clarifications:

- 1. Updated drawings set with information on finishes, fire-rated doors, ceiling heights, bulkheads, and existing MEP fixtures. Please read all clouded notes and comments on the architectural and MEP drawings.**



FLOYD COUNTY ANNEX RENOVATION 2ND & 3RD FLOORS

120 W SPRING ST
NEW ALBANY, INDIANA


BID SET

FLOYD COUNTY
ANNEX
RENOVATION 2ND
& 3RD FLOORS 120
W. SPRING

NEW ALBANY INDIANA

COVER

REVISIONS



LMH
ARCHITECTURE

LMH ARCHITECTURE + MAR ARCHITECTS
12808 TOWNPARK WAY, SUITE 200
LOUISVILLE, KY 40243
502.581.0570
319 BANK STREET
NEW ALBANY, IN 47150
812.945.2324
WWW.LMHARCHITECTURE.COM

PROJECT NUMBER

FCI2501

DATE

JUNE 12, 2025

SHEET NUMBER

COVER

FLOYD COUNTY
ANNEX
RENOVATION 2ND
& 3RD FLOORS 120
W. SPRING

NEW ALBANY INDIANA

CODE CRITERIA -
LEGENDS AND
ABBREVIATIONS

REVISIONS


REVISIONS

REVISIONS

REVISIONS

REVISIONS

REVISIONS



PROJECT INFORMATION

PROJECT DESCRIPTION:

OFFICE RENOVATIONS TO 2ND AND 3RD FLOORS TO ACCOMMODATE FLOYD COUNTY ADMINISTRATIVE AND PUBLIC OFFICES

12808 TOWNPARK WAY, SUITE 200
LOUISVILLE, KY 40243
502.581.0570
WWW.LMHARCHITECTURE.COM

PROJECT NUMBER
FCI2501

DATE
JUNE 12, 2025
SHEET NUMBER
X1

APPLICABLE CODES

BUILDING CODE:
2014 INDIANA BUILDING CODE
(2012 IBC WITH AMENDMENTS)

LIFE SAFETY CODE:
2012 NFPA 101 - LIFE SAFETY CODE

ACCESSIBILITY CODE:
2009 ANSI A117.1 WITH AMENDMENTS

FIRE CODE:
2014 INDIANA FIRE CODE
(2012 INTERNATIONAL FIRE CODE)

PLUMBING CODE:
2012 INDIANA PLUMBING CODE
(2006 INTERNATIONAL PLUMBING CODE WITH AMENDMENTS)

MECHANICAL CODE:
2014 INDIANA MECHANICAL CODE
(2012 INTERNATIONAL MECHANICAL CODE)

ELECTRICAL CODE:
2009 INDIANA ELECTRIC CODE
(2008 NFPA 70 - NATIONAL ELECTRIC CODE)

ENERGY CODE:
2010 INDIANA ENERGY CONSERVATION CODE
(2007 ASHRAE 90.1)

FUEL AND GAS CODE:
2014 INDIANA FUEL GAS CODE
(2012 NATIONAL FUEL GAS CODE)

BUILDING CLASSIFICATION

OCCUPANCY:
CLASSIFICATION (I.B.C.): B
NFPA 101 BUSINESS

FULLY SPRINKLED:
PER NFPA 13

TYPE OF CONSTRUCTION:
INTERNATIONAL BUILDING CODE: IB
NFPA 101 LIFE SAFETY CODE: II(222)

PROJECT SQUARE FOOTAGE

SECOND FLOOR: 5,173 SF
THIRD FLOOR: 5,173 SF
FOURTH FLOOR: 5,173 SF

TOTAL: 15,519 SF

SHEET INDEX

GENERAL COVER: XI
COVER: CODE CRITERIA - LEGENDS AND ABBREVIATIONS

ARCHITECTURAL

A1.1 LIFE SAFETY PLAN
A2.1 DEMOLITION PLANS - 2ND & 3RD FLOORS
A3.1 FLOOR PLAN - SECOND FLOOR
A3.2 FLOOR PLAN - THIRD FLOOR
A5.1 REFLECTED CEILING PLAN - 2ND & 3RD FLOORS
A11.1 INTERIOR ELEVATIONS
A14.1 DOOR SCHEDULE AND DETAILS
A15.1 ROOM FINISH SCHEDULE

HVAC

H-0.01 MECHANICAL GENERAL NOTES LEGEND AND ABBREVIATIONS
H-1.01 SECOND & THIRD FLOOR MECHANICAL DEMO PLAN
H-2.01 SECOND & THIRD FLOOR MECHANICAL NEW PLAN
H-4.01 MECHANICAL SCHEDULES
H-5.01 MECHANICAL DETAILS

ELECTRICAL

EO.01 ELECTRICAL GENERAL NOTES LEGEND AND ABBREVIATIONS
E2.21 SECOND & THIRD FLOOR SYSTEM NEW PLAN
E-1.01 SECOND & THIRD FLOOR LIGHTING DEMO PLAN
E-1.11 SECOND & THIRD FLOOR POWER DEMO PLAN
E-1.21 SECOND & THIRD FLOOR SYSTEM DEMO PLAN
E-2.01 SECOND & THIRD FLOOR LIGHTING NEW PLAN
E-2.11 SECOND & THIR FLOOR POWER NEW PLAN
E-4.01 ELECTRICAL SCHEDULES & ONE-LINE DIAGRAM

FIRE PROTECTION

FP-0.01 FIRE PROTECTION GENERAL NOTES LEGEND AND ABBREVIATIONS
FP-1.01 SECOND & THIRD FLOOR FIRE PROTECTION DEMO PLAN
FP-2.01 SECOND & THIRD FLOOR FIRE PROTECTION NEW PLAN

MATERIALS LEGEND

	EARTH/FILL
	CONCRETE
	CONCRETE MASONRY UNIT
	STEEL
	WOOD BLOCKING
	FINISH WOOD
	PLYWOOD/PARTICLE BOARD
	INSULATION BOARD
	BATT INSULATION
	EXTERIOR INSULATION FINISH SYSTEM
	GYPSUM WALLBOARD

ABBREVIATIONS

AFF	ABOVE FINISHED FLOOR	JAN	JANITOR
AL	ALUMINUM	MECH	MECHANICAL
CPT	CARPET	MED PREP	MEDICINE PREPARATION
CH	CEILING HEIGHT	MIN	MINIMUM
CFCI	CONTRACTOR FURNISHED CONTRACTOR INSTALLED CORNER GUARD	NTS	NOT TO SCALE
CG	CORNER GUARD	OFCI	OWNER FURNISHED CONTRACTOR INSTALLED ON CENTER
CJ	CONTROL JOINT	OFOI	OWNER FURNISHED CONTRACTOR INSTALLED OPERATING ROOM
CL	CENTER LINE	OR	OWNER INSTALLED OPERATING ROOM
CMU	CONCRETE MASONRY UNIT	PT	PAINT
CT	CERAMIC TILE	QT	QUARRY TILE
DEPT	DEPARTMENT	REF	REFRIGERATOR
DN	DOWN	RB	RESILIENT BASE
EIFS	EXTERIOR INSULATED FINISH SYSTEM	SCW	SOLID CORE WOOD
EJ	EXPANSION JOINT	SAC	SUSPENDED ACOUSTICAL CEILING
ELEC	ELECTRICAL	SIM	SIMILAR
ELEV	ELEVATOR	SS	STAINLESS STEEL
EQ	EQUAL	TYP	TYPICAL
ETR	EXISTING TO REMAIN	VCT	VINYL COMPOSITION TILE
FD	FLOOR DRAIN	VERT	VERTICAL
FE	FIRE EXTINGUISHER	VWC	VINYL WALL COVERING
FEC	FIRE EXTINGUISHER CABINET	WD	WOOD
FFE	FINISHED FLOOR ELEVATION	WS	WEATHER STRIP
FHC	FIRE HOSE CABINET	WSV	WELDED SHEET VINYL
FR	FIRE RETARDANT FIRE RATED	WWM	WELDED WIRE MESH
GALV	GALVANIZED		
GWB	GYPSUM WALLBOARD		
HM	HOLLOW METAL		
HVAC	HEATING VENTILATION AIR CONDITIONING		

SYMBOLS LEGEND

1 COLUMN LINES

10 DOOR AND DOOR NUMBER

20 WINDOW ELEVATION NUMBER

--- PARTITION TYPES

100'-0" ELEVATION ABOVE FINISH FLOOR


VIEW SHEET EXTERIOR WALL SECTION CUT

VIEW INTERIOR DETAIL CUT

VIEW SHEET VIEW INTERIOR ELEVATION

MATCH LINE

SHEET NO. SYSTEM

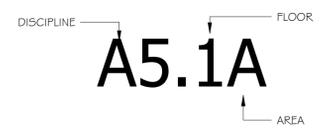

PARTITION LEGEND

	1-HR. RATED SMOKE BARRIER
	1-HR. RATED FIRE SEPERATION
	2-HR. RATED FIRE SEPERATION
	1-HR. RATED FIRE AND SMOKE SEPERATION
	2-HR. RATED FIRE AND SMOKE SEPERATION
	NON-RATED PARTITION

VICINITY MAP


ALTERNATES

FLOYD COUNTY
ANNEX
RENOVATION 2ND
& 3RD FLOORS 120
W. SPRING

NEW ALBANY INDIANA


LIFE SAFETY PLAN

REVISIONS
2 ADDENDUM #2 07.07.25




LMH
ARCHITECTURE
ARCHITECTURE + MAF ARCHITECTS
12808 TOWNPARK WAY, SUITE 200
LOUISVILLE, KY 40243
502.581.0570
WWW.LMHARCHITECTURE.COM


PROJECT NUMBER
FCI2501
DATE
JUNE 12, 2025
SHEET NUMBER
A1.1

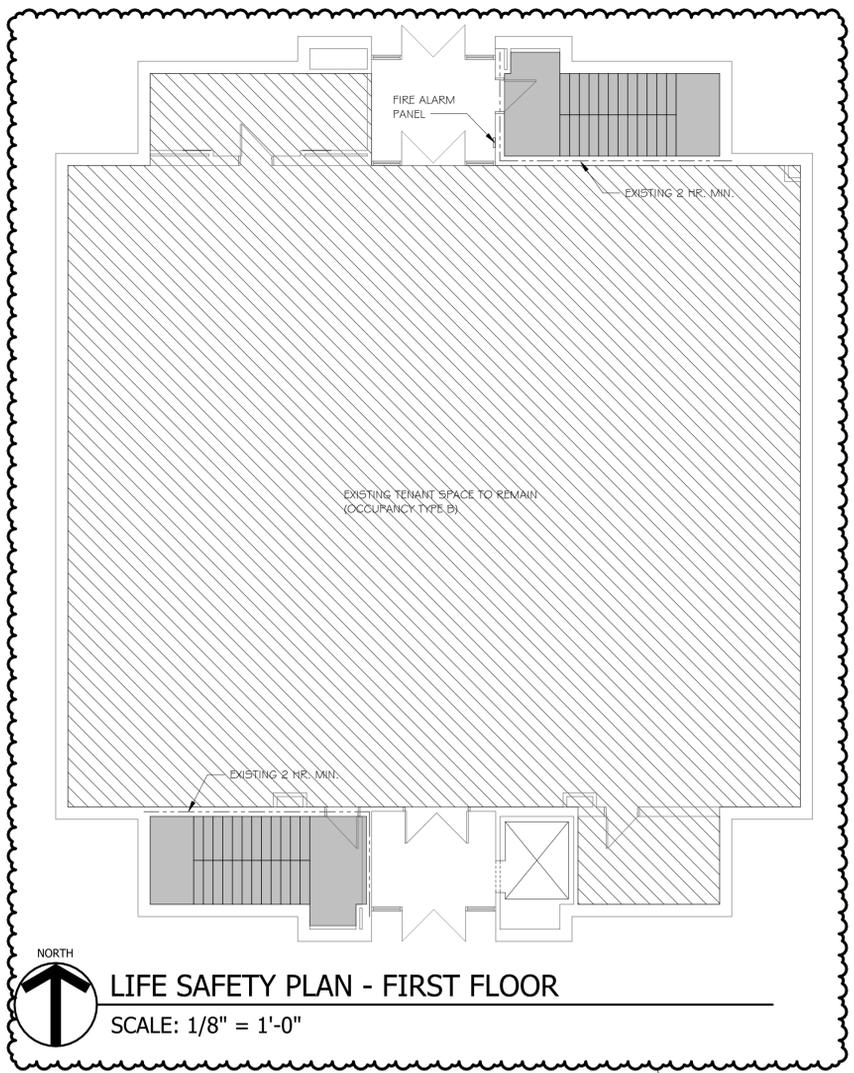

NORTH
LIFE SAFETY PLAN - FIRST FLOOR
SCALE: 1/8" = 1'-0"

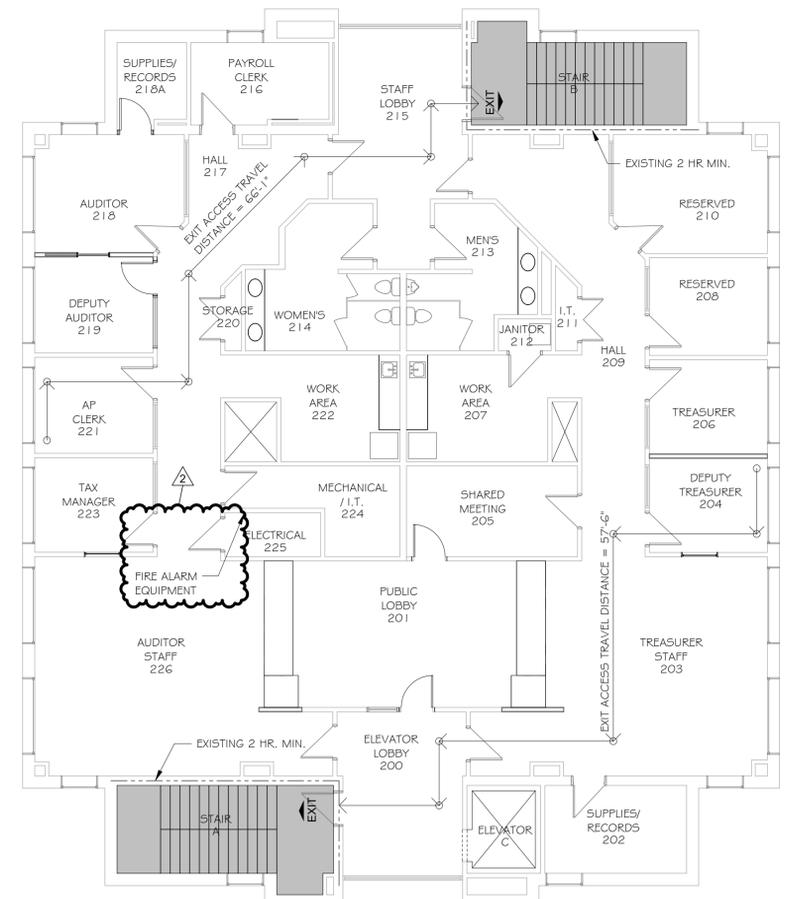

NORTH
LIFE SAFETY PLAN - SECOND FLOOR
SCALE: 1/8" = 1'-0"

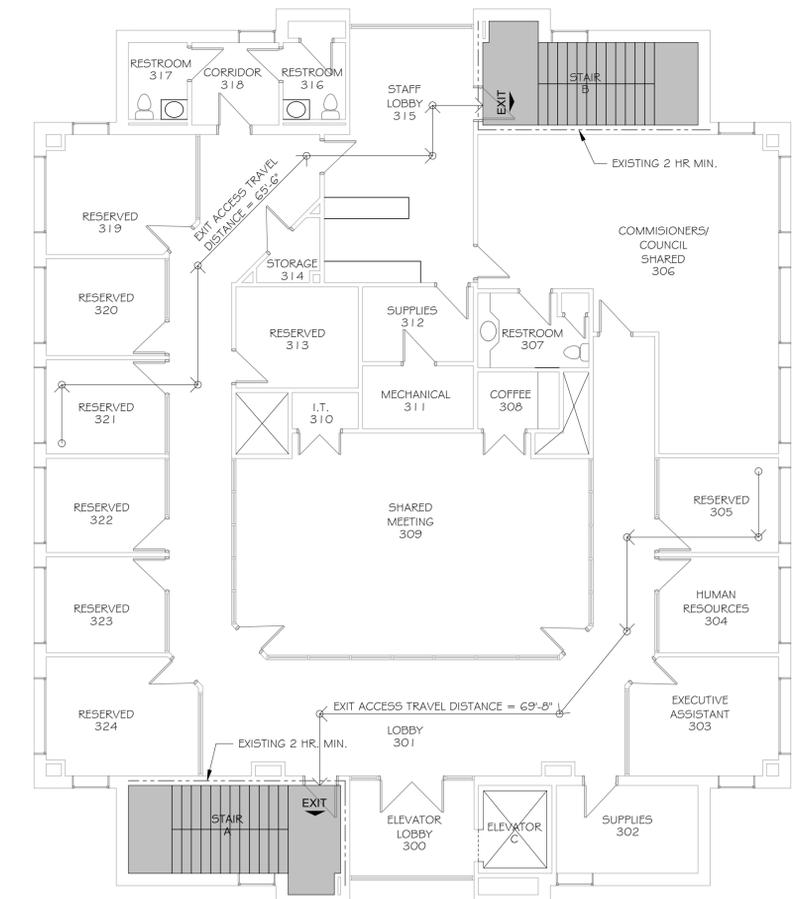

NORTH
LIFE SAFETY PLAN - THIRD FLOOR
SCALE: 1/8" = 1'-0"


LIFE SAFETY LEGEND

- 2 HOUR FIRE RATED BARRIER
 - NEW
 - - - EXISTING
- EXIT ACCESS STAIR
 - NEW
 - EXISTING
- WALLS SHALL FORM A BARRIER TO LIMIT THE TRANSFER OF SMOKE
- RATED STAIR DOORS - CONSTRUCTED TO RESIST THE PASSAGE OF SMOKE. DOORS HARDWARE SHALL BE POSITIVE LATCHING WITH THE EXCEPTION OF TOILET ROOMS, BATHROOMS, SHOWER ROOMS, SINK CLOSETS, AND SIMILAR AUXILIARY SPACES THAT DO NOT CONTAIN FLAMMABLE OR COMBUSTIBLE MATERIALS.
- 34" CLEAR EGRESS WIDTH

TABLE OF EXIT CAPACITY

COMPARTMENT	AREA	OCCUPANCY CLASSIFICATION	SQUARE FEET PER OCCUPANT	NUMBER OF OCCUPANTS	INCHES PER OCCUPANT	INCHES REQUIRED OTHER EGRESS	INCHES PROVIDED
SECOND FLOOR	4,690 SF	GROUP B	100	47	0.2	10"	72"
THIRD FLOOR	4,690 SF	GROUP B	100	47	0.2	10"	72"
TOTAL	9,380 SF		100	94	0.2	20"	72"

DEMOLITION LEGEND


-  EXISTING WALL TO REMAIN
-  EXISTING WALL TO BE DEMOLISHED
-  EXISTING WALL CONSTRUCTION TO REMAIN
EXISTING DOOR AND FRAME TO REMAIN
-  EXISTING WALL CONSTRUCTION TO REMAIN
EXISTING DOOR AND FRAME TO BE REMOVED
-  EXISTING WALL CONSTRUCTION TO BE DEMOLISHED
EXISTING DOOR AND FRAME TO BE REMOVED

GENERAL DEMOLITION NOTES


- A. SCHEDULE DEMOLITION WORK WITH THE OWNER OR OWNER'S REP TO MINIMIZE THE DISRUPTION OF SERVICES AND PROVIDE FOR THE UNINTERRUPTED FUNCTIONING OF THE FACILITY.
- B. CUT AND PATCH AS REQUIRED FOR INSTALLATION OF WORK ITEMS. REFER TO MECHANICAL, PLUMBING, FIRE PROTECTION, AND ELECTRICAL DOCUMENTS FOR ADDITIONAL CUTTING REQUIREMENTS.
- C. PROVIDE TEMPORARY SUPPORT WHERE DEMOLITION AFFECTS STRUCTURE. PRIOR TO COMMENCING DEMOLITION WORK, NOTIFY ARCHITECT OF FIELD CONDITIONS PRESENTING HAZARD CONDITION FOR BUILDING OR OCCUPANTS.
- D. REMOVE EXISTING FINISHES AS NECESSARY IN AREAS RECEIVING NEW FINISHES. PROTECT SURROUNDING AREA FINISHES.
- E. LEGALLY DISPOSE ITEMS REJECTED BY THE OWNER.
- F. COORDINATE UTILITY SHUT DOWNS AND DISCONNECTS WITH OWNER.
- G. SALVAGE REQUIRED QUANTITY OF STAINED WOOD TRIM, FLOOR BASE, DOORS, BORROWED LIGHT GLASS AND FRAMES TO REUSE.

DEMOLITION KEYNOTES


- 0.01 REMOVE EXISTING WALL
- 0.02 REMOVE EXISTING DOOR AND TRIM
- 0.03 REMOVE EXISTING DOOR AND TRANSOM
- 0.04 REMOVE EXISTING BORROWED LITE GLASS
- 0.05 REMOVE EXISTING CASEWORK
- 0.06 REMOVE EXISTING PLUMBING FIXTURES
- 0.07 CREATE OPENING IN EXISTING WALL FOR NEW DOOR INSTALLATION
- 0.08 CREATE OPENING IN EXISTING WALL FOR NEW BORROWED LITE INSTALLATION
- 0.09 SALVAGE EXISTING DOOR AND TRIM FOR REUSE
- 0.10 SALVAGE EXISTING CARPET TILE FOR REUSE
- 0.11 SALVAGE EXISTING BORROWED LITE GLASS AND TRIM FOR REUSE

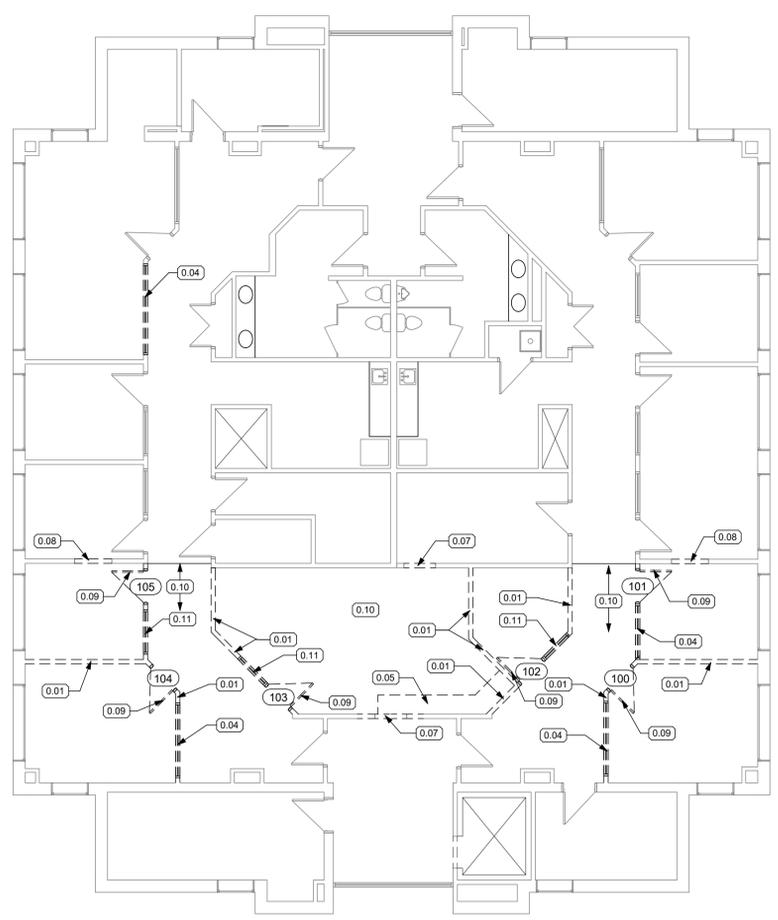

DEMOLITION PLAN - SECOND FLOOR
SCALE: 1/8" = 1'-0"

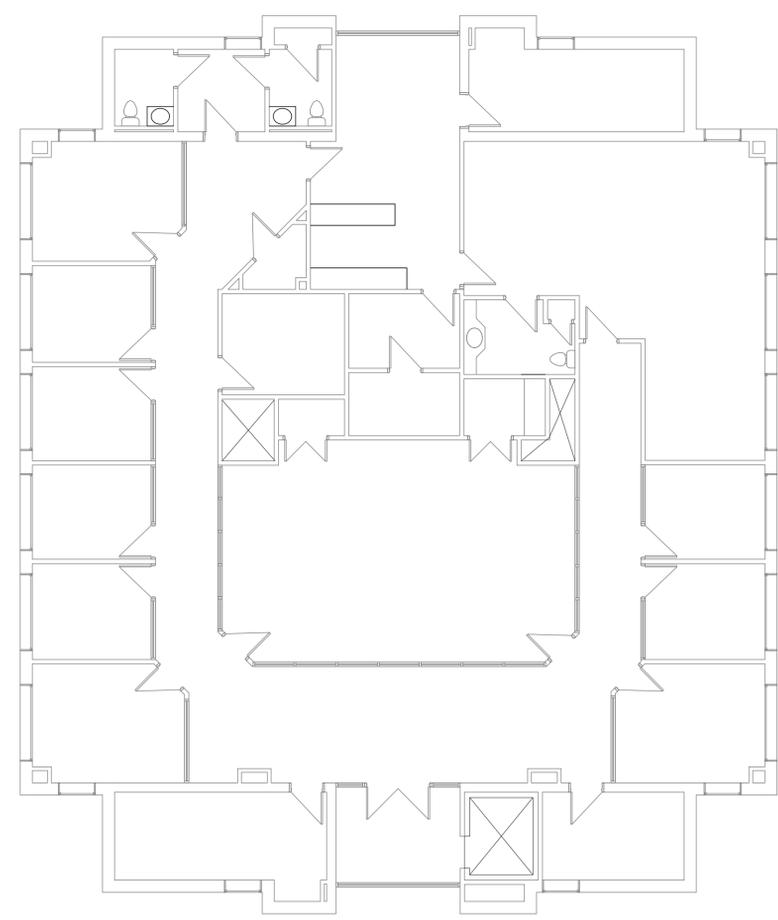


DEMOLITION PLAN - THIRD FLOOR
SCALE: 1/8" = 1'-0"



LMH ARCHITECTURE + MAR ARCHITECTS
12808 TOWNPARK WAY, SUITE 200
LOUISVILLE, KY 40243
502.581.0570
WWW.LMHARCHITECTURE.COM

PROJECT NUMBER	FCI2501
DATE	JUNE 12, 2025
SHEET NUMBER	A2.1

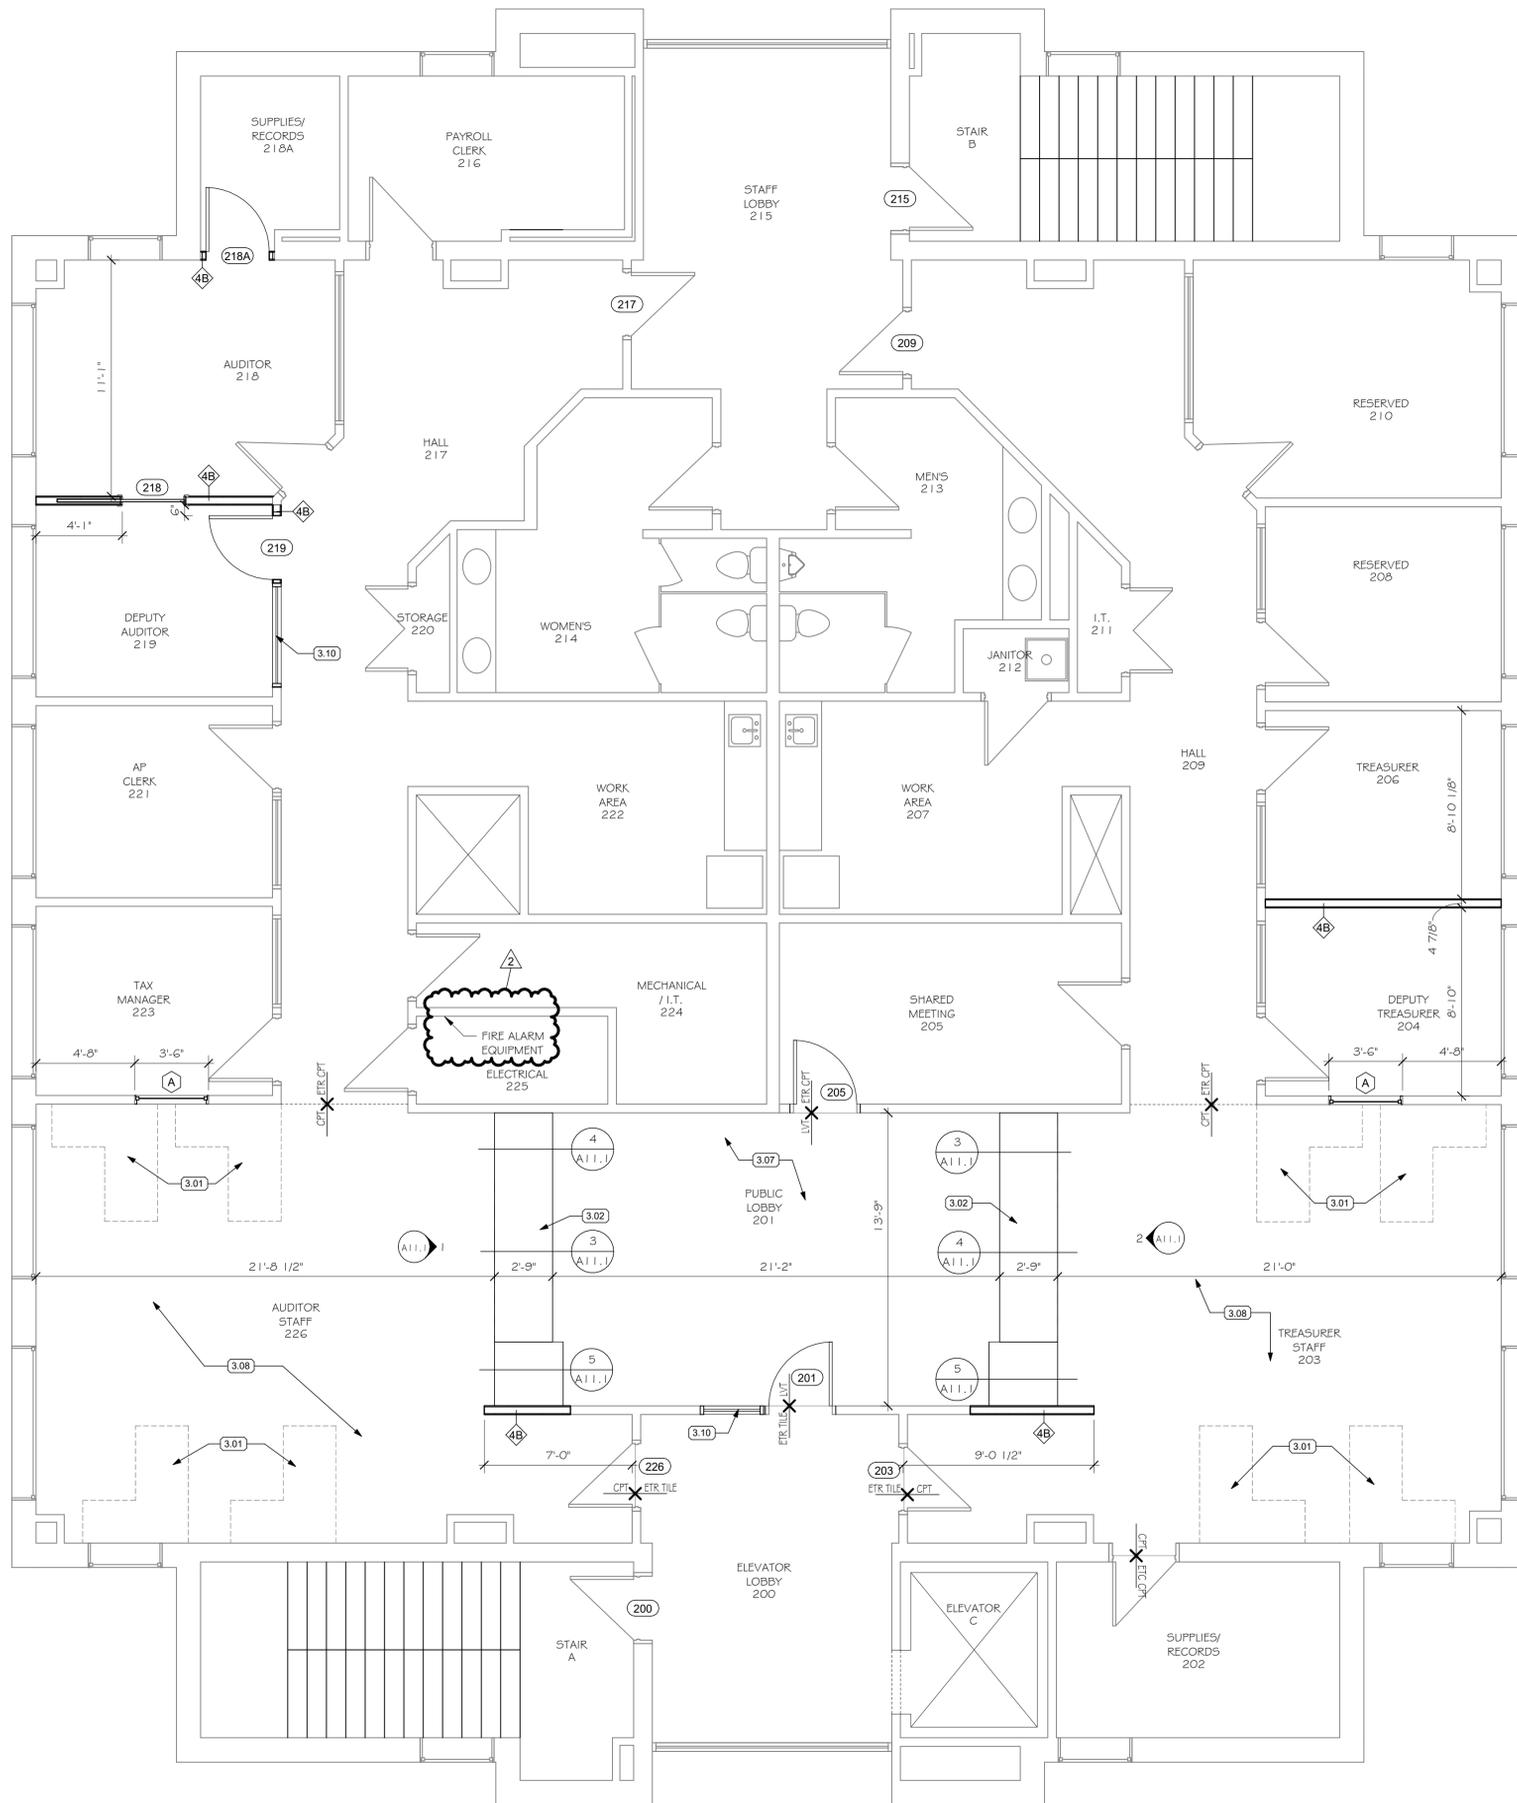


1 FLOOR PLAN - SECOND FLOOR
1/4" = 1'-0"

GENERAL PLAN NOTES

- A. DIMENSIONS ARE FROM FACE OF FINISHED SURFACE TO FACE OF FINISHED SURFACE.
- B. DIMENSIONS NOTED AS "CLEAR" ARE FROM FINISHED FACE TO FINISHED FACE.
- C. INTERIOR PARTITIONS SHALL BE 3-5/8" 20 GAGE METAL STUDS @ 16" O.C. UNLESS NOTED OTHERWISE.
- D. INTERIOR PARTITIONS TYPES ARE INDICATED ON SHEET A3.1.
- E. PATCH AND REPAINT TO MATCH EXISTING WALL CORNER TO CORNER IN ROOMS WHERE WORK IS BEING COMPLETED.
- F. IN ROOMS WITH NO WORK BEING COMPLETED EXISTING FINISHES TO REMAIN. PROTECT DURING CONSTRUCTION TO ADJACENT AREAS.
- G. WHERE EXISTING WALL WAS REMOVED PATCH DRYWALL TO MATCH ADJACENT FINISH. PAINT ENTIRE WALL FROM INSIDE CORNER TO INSIDE CORNER.
- H. PATCH AS REQUIRED AND PAINT ALL WALLS ON SECOND FLOOR.

FLOOR PLAN KEY NOTES

- 3.01 FURNITURE (NOT IN CONTRACT)
- 3.02 BUILT IN F-LAM CASEWORK
- 3.03 OFFICE EQUIPMENT (NOT IN CONTRACT)
- 3.04 NEW SINK
- 3.05 REFRIGERATOR (NOT IN CONTRACT)
- 3.06 KNAPE & VOST EXTRA HEAVY DUTY STANDARDS AND BRACKETS ADJUSTABLE SHELVING SYSTEM.
- 3.07 NEW LVT FLOORING AT ENTIRE EXTENT OF ROOM
- 3.08 NEW CARPET TILE FLOORING AT ENTIRE EXTENT OF ROOM
- 3.10 REINSTALL SALVAGED BORROWED LITE WINDOW, FIELD VERIFY SIZE
- 3.11 RELOCATED OFFICE FILE AND STORAGE CABINET (NOT IN CONTRACT)
- 3.12 PUBLIC COMPUTER STATION WORK COUNTER
- 3.14 ALIGN FACE OF COUNTER WITH INDICATED ADJACENT ARCHITECTURAL ELEMENT

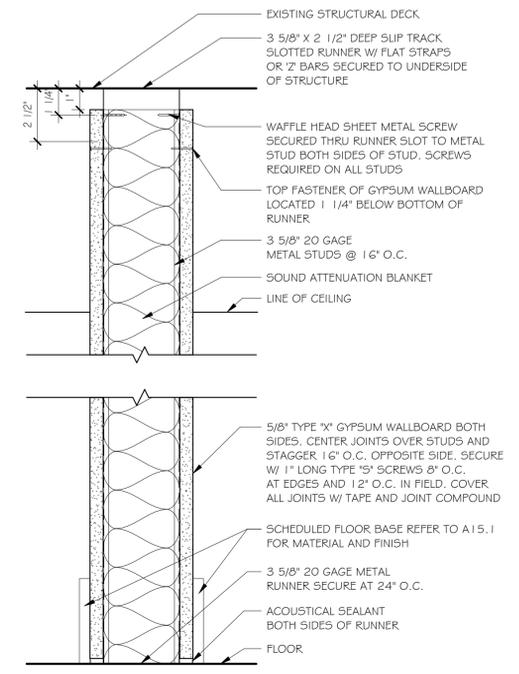


4B - WALL TYPE
SCALE: 3" = 1'-0"

FLOYD COUNTY
ANNEX
RENOVATION 2ND
& 3RD FLOORS 120
W. SPRING

NEW ALBANY INDIANA


FLOOR PLAN - SECOND
FLOOR

REVISIONS
2 ADDENDUM #2 07.07.25



LMH ARCHITECTURE
ARCHITECTURE + MAF ARCHITECTS
12808 TOWNPARK WAY, SUITE 200
LOUISVILLE, KY 40243
502.581.0570
WWW.LMHARCHITECTURE.COM

PROJECT NUMBER
FCI2501
DATE
JUNE 12, 2025
SHEET NUMBER
A3.1

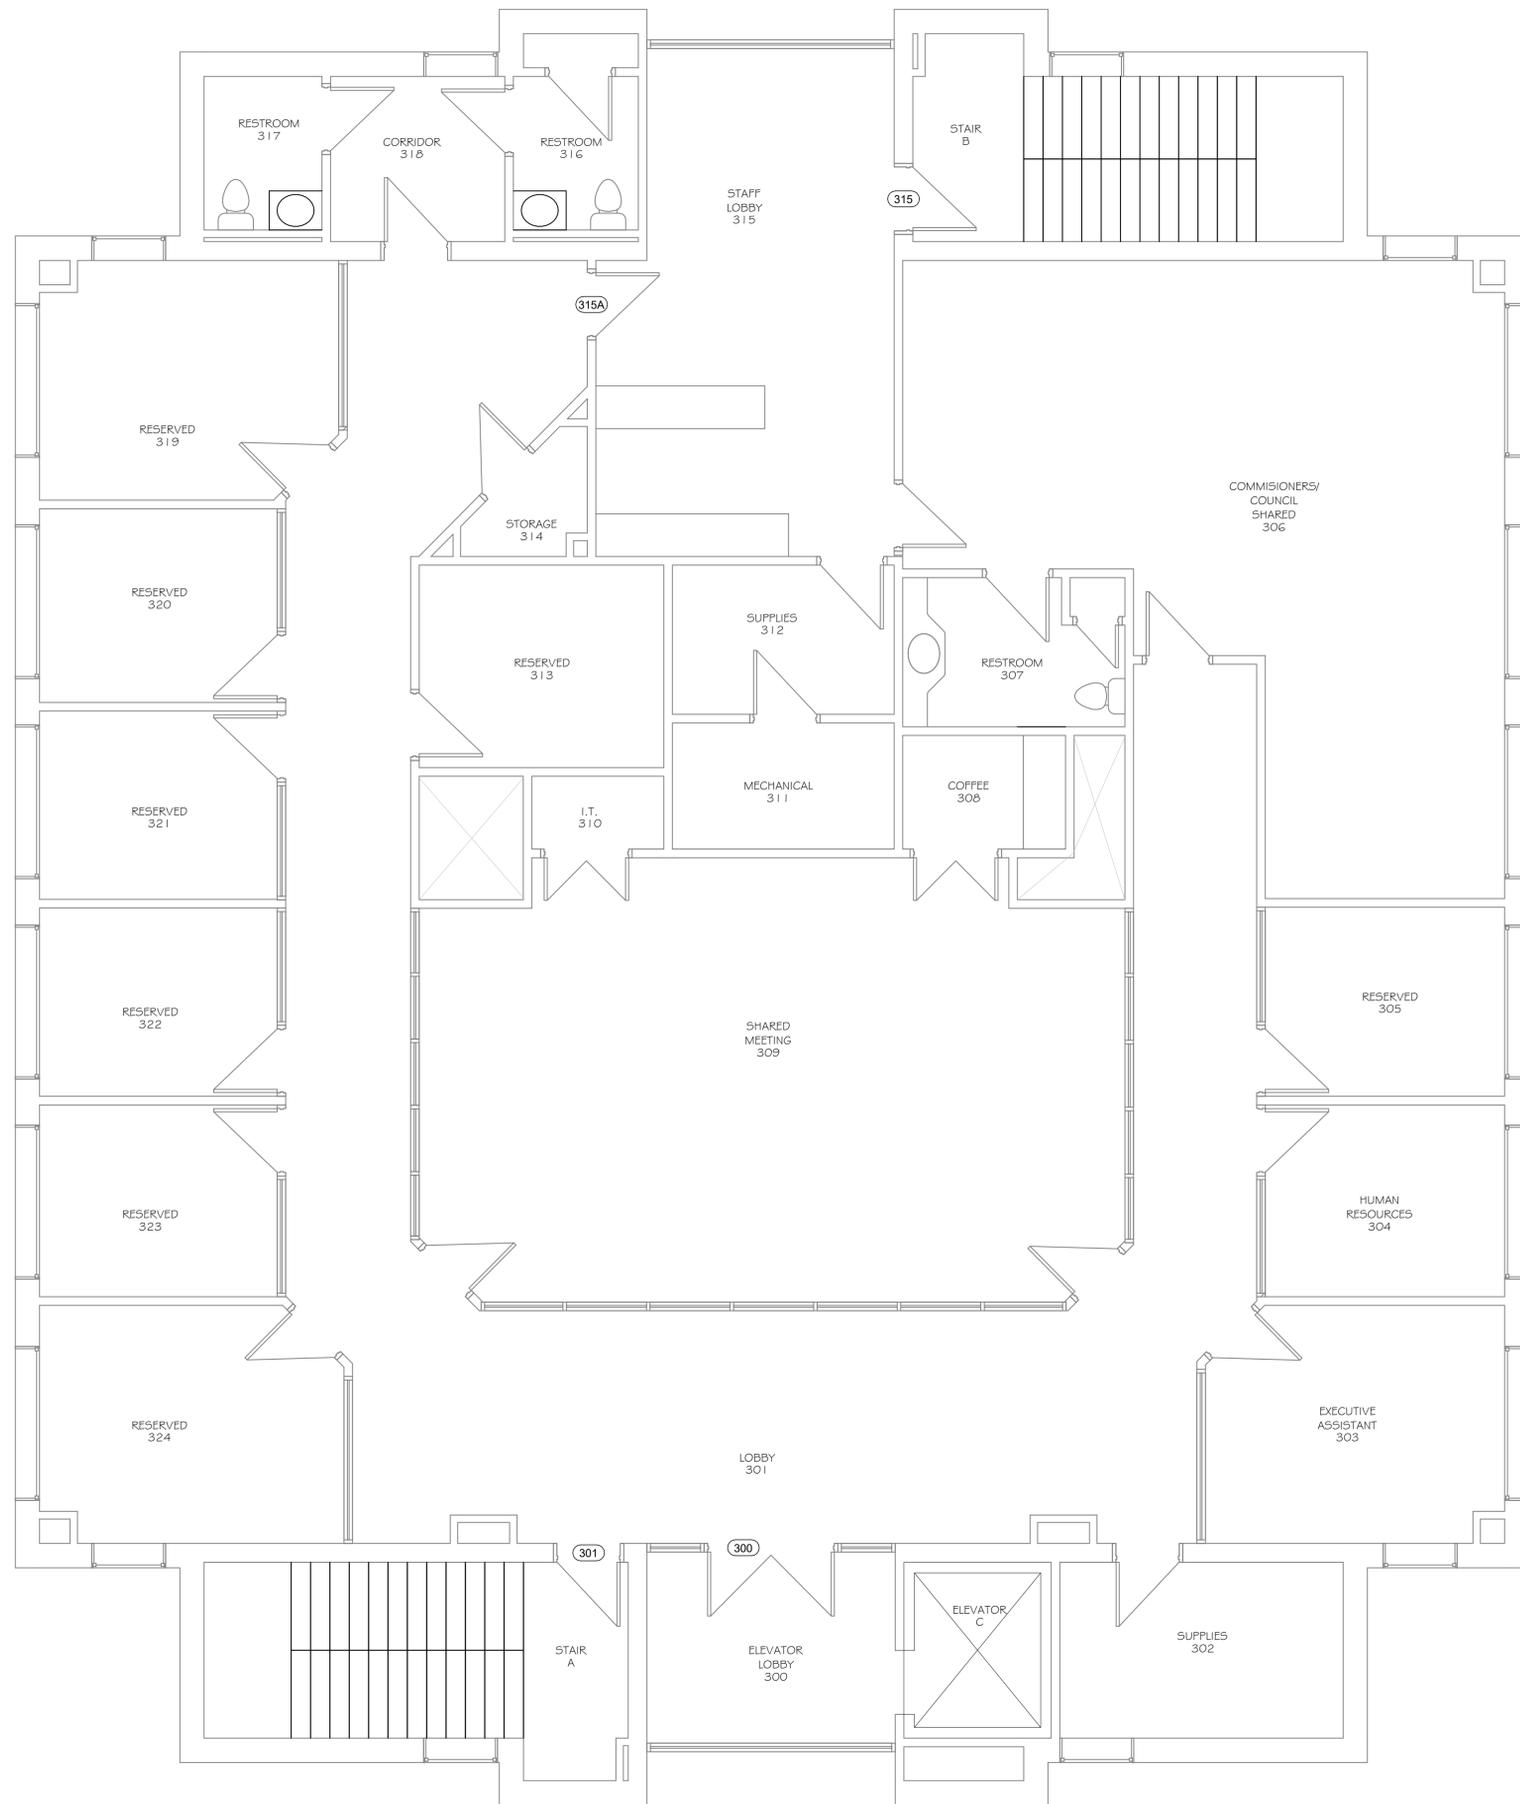

1 FLOOR PLAN - THIRD FLOOR
SCALE: 1/4" = 1'-0"

GENERAL PLAN NOTES


- A. DIMENSIONS ARE FROM FACE OF FINISHED SURFACE TO FACE OF FINISHED SURFACE.
- B. DIMENSIONS NOTED AS "CLEAR" ARE FROM FINISHED FACE TO FINISHED FACE.
- C. INTERIOR PARTITIONS SHALL BE 3-5/8" 20 GAGE METAL STUDS @ 16" O.C. UNLESS NOTED OTHERWISE.
- D. INTERIOR PARTITIONS TYPES ARE INDICATED ON SHEET A3.1.
- E. PATCH AND REPAINT TO MATCH EXISTING WALL CORNER TO CORNER IN ROOMS WHERE WORK IS BEING COMPLETED.
- F. IN ROOMS WITH NO WORK BEING COMPLETED EXISTING FINISHES TO REMAIN. PROTECT DURING CONSTRUCTION TO ADJACENT AREAS..
- G. WHERE EXISTING WALL WAS REMOVED PATCH DRYWALL TO MATCH ADJACENT FINISH. PAINT ENTIRE WALL FROM INSIDE CORNER TO INSIDE CORNER.
- H. PATCH AS REQUIRED AND PAINT ALL WALLS ON SECOND FLOOR.

FLOYD COUNTY
ANNEX
RENOVATION 2ND
& 3RD FLOORS 120
W. SPRING

NEW ALBANY INDIANA


FLOOR PLAN - THIRD
FLOOR

REVISIONS



LMH ARCHITECTURE
ARCHITECTURE + MAP ARCHITECTS
12808 TOWNPARK WAY, SUITE 200
LOUISVILLE, KY 40243
502.581.0570
WWW.LMHARCHITECTURE.COM
319 BANK STREET
NEW ALBANY, IN 47150
812.945.2324

PROJECT NUMBER	FCI2501
DATE	JUNE 12, 2025
SHEET NUMBER	A3.2

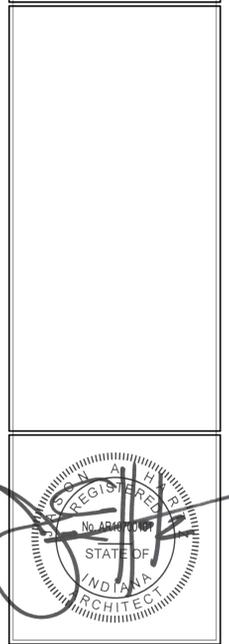

WALL RATING LEGEND

- SMOKE PARTITION
- SMOKE COMPARTMENT BARRIER WALL (1 HOUR RATED CONSTRUCTION WITH 20 MINUTE OPENING PROTECTION)
- 1 HOUR FIRE RATED PARTITION
- 2 HOUR FIRE RATED PARTITION
- 1 HOUR FIRE RATED SMOKE COMPARTMENT BARRIER WALL
- 2 HOUR RATED SMOKE COMPARTMENT BARRIER WALL

GENERAL REFLECTED CEILING NOTES


- A. MATCH NEW CEILING GRID AND TILE TO THE EXISTING STYLE AND COLOR OF ADJACENT CEILING.
- B. NEW CEILING TO BE SAME AS EXISTING CEILING HEIGHT AS ADJACENT CEILING. CEILING HEIGHT IS 9'-0" UNLESS OTHERWISE NOTED.
- C. WHERE POSSIBLE MODIFY EXISTING GRID LAYOUT TO ACCOMMODATE NEW PLAN LAYOUT. REUSE EXISTING TILES IN GOOD CONDITION.

REFLECTED CEILING PLAN LEGEND

- 2X2 ACOUSTICAL CEILING GRID AND PANELS
- 2X4 ACOUSTICAL CEILING GRID AND PANELS
- GYPSUM WALLBOARD CEILING
- 2X4' RECESSED FLUORESCENT FIXTURE-COORDINATE WITH ELECTRICAL DRAWINGS
- 2X2' RECESSED FLUORESCENT FIXTURE-COORDINATE WITH ELECTRICAL DRAWINGS
- RECESSED DOWNLIGHT FIXTURE-COORDINATE WITH ELECTRICAL DRAWINGS
- SMOKE DETECTOR-COORDINATE WITH ELECTRICAL DRAWINGS
- HEAT DETECTOR-COORDINATE WITH ELECTRICAL DRAWINGS
- CEILING MOUNTED EXIT SIGN-COORDINATE WITH ELECTRICAL DRAWINGS
- RETURN AIR DIFFUSER OR REGISTER-COORDINATE WITH MECHANICAL DRAWINGS
- SUPPLY AIR DIFFUSER OR REGISTER-COORDINATE WITH MECHANICAL DRAWINGS
- EXHAUST FAN-COORDINATE WITH MECHANICAL DRAWINGS
- PENDANT LIGHT FIXTURE-COORDINATE WITH ELECTRICAL DRAWINGS
- LOCKABLE ACCESS PANEL


REFLECTED CEILING KEYNOTES

- 5.01 EXISTING CEILING TO REMAIN.
- 5.02 NEW GYPSUM BOARD BULKHEAD @ 8'-11" A.F.F., FACES OF BULKHEAD TO MATCH ADJACENT WALL FINISH. BOTTOM OF BULKHEAD TO BE CEILING WHITE PAINT. SEE DETAIL 3/A5.1
- 5.03 NEW LAY IN ACOUSTICAL 2X2 CEILING. MATCH HEIGHT OF ADJACENT EXISTING ACOUSTICAL LAY-IN CEILING (9'-0" UNLESS OTHERWISE NOTED)
- 5.04 MODIFY EXISTING ACOUSTICAL CEILING AS REQUIRED.
- 5.05 NEW GYPSUM BOARD BULKHEAD @ 8'-6" A.F.F., FACES OF BULKHEAD TO MATCH ADJACENT WALL FINISH. BOTTOM OF BULKHEAD TO BE CEILING WHITE PAINT. SEE DETAIL 4/A5.1
- 5.06 EXISTING GYPSUM BOARD BULKHEAD AND CURTAIN POCKET TO REMAIN.

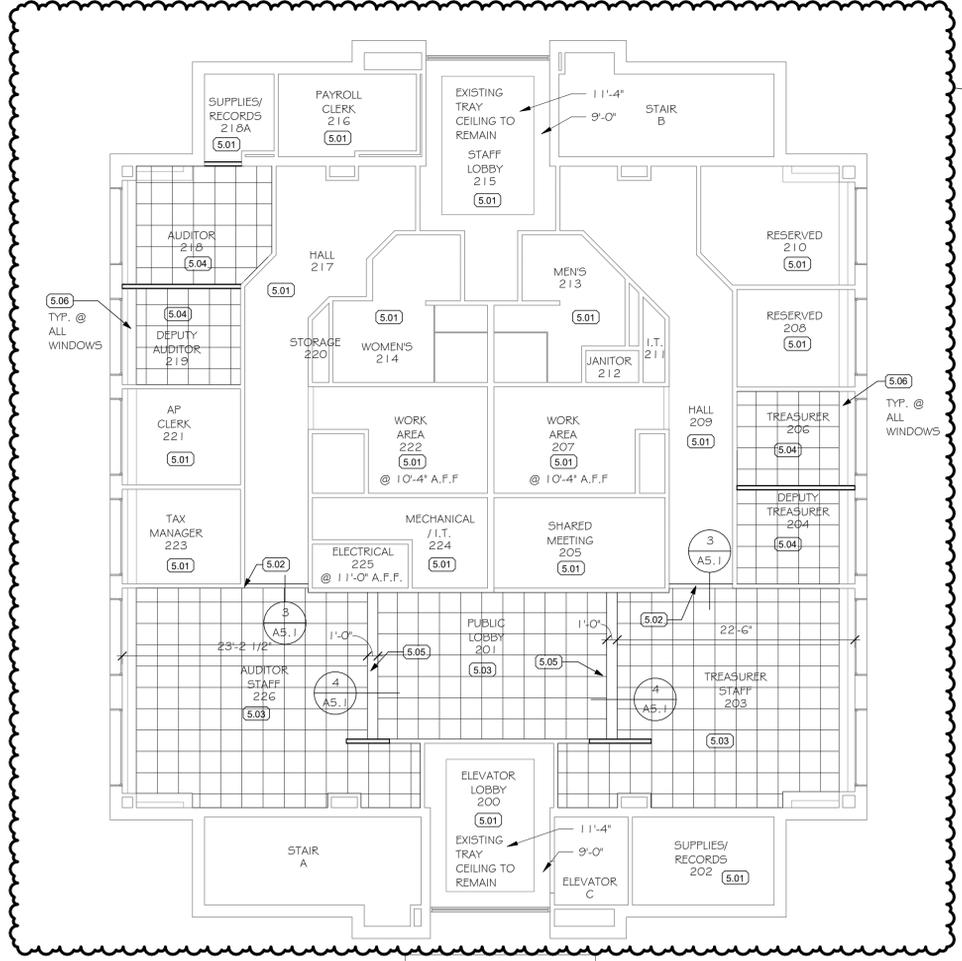


REFLECTED CEILING PLAN - 2ND FLOOR

SCALE: 1/8" = 1'-0"

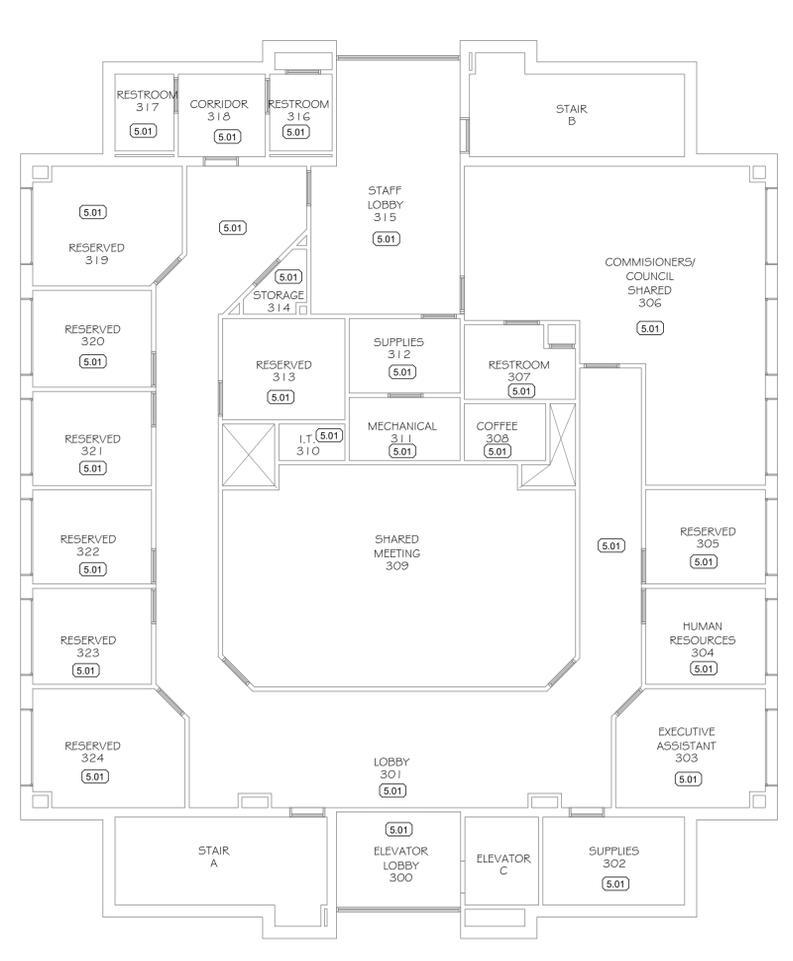


REFLECTED CEILING PLAN - 3RD FLOOR

SCALE: 1/8" = 1'-0"

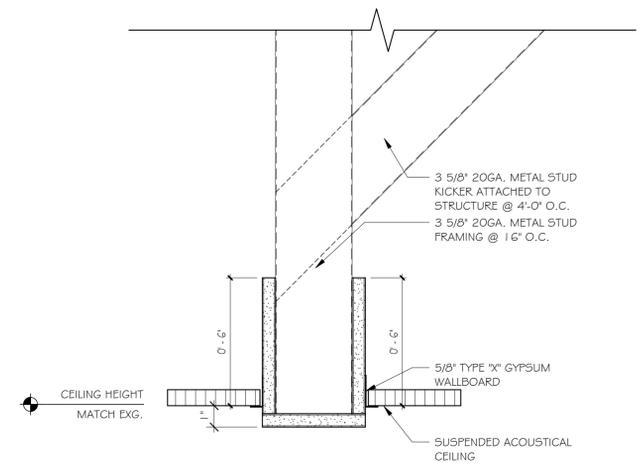


3 BULKHEAD DETAIL

SCALE: 3" = 1'-0"

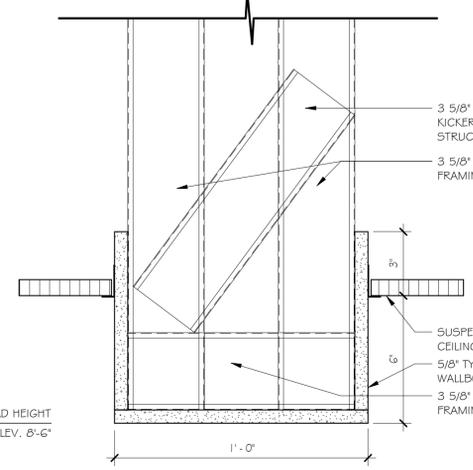


4 BULKHEAD DETAIL


SCALE: 3" = 1'-0"

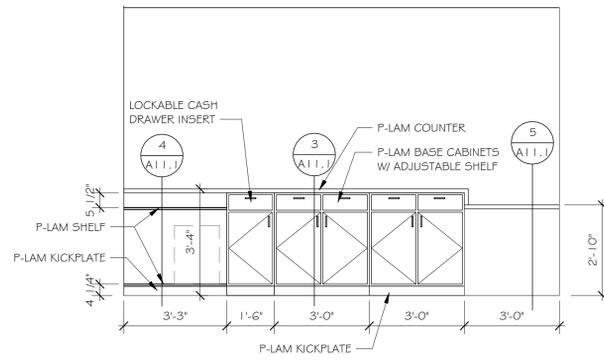


1 AUDITOR TRANSACTION COUNTER
3/8" = 1'-0"

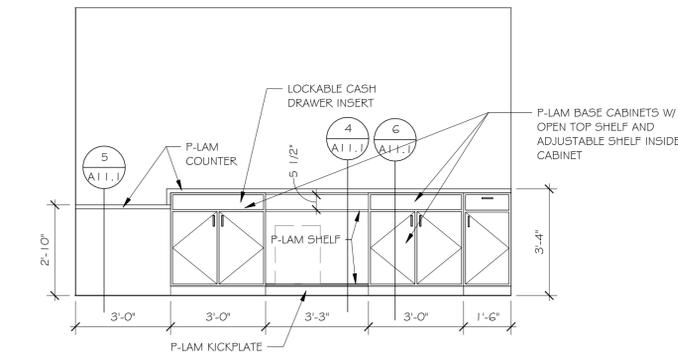


2 TREASURER TRANSACTION COUNTER
3/8" = 1'-0"

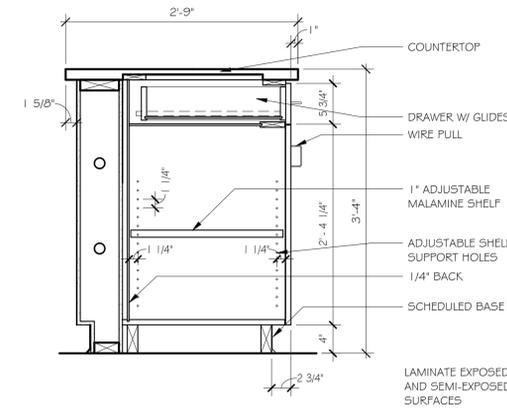


3 BASE SECTION
1" = 1'-0"

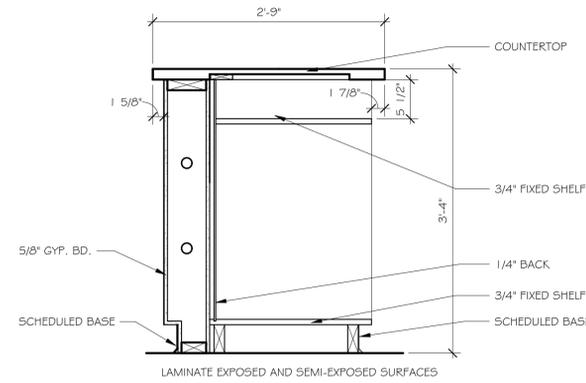

4 BASE SECTION OPEN SHELVES
1" = 1'-0"

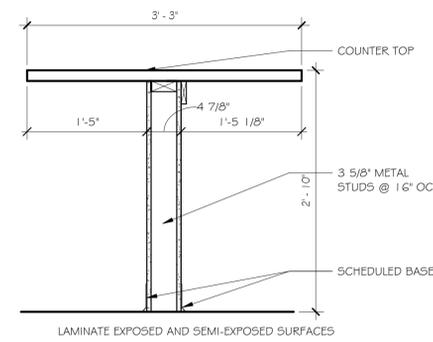

5 KNEE SPACE BOTH SIDES
1" = 1'-0"

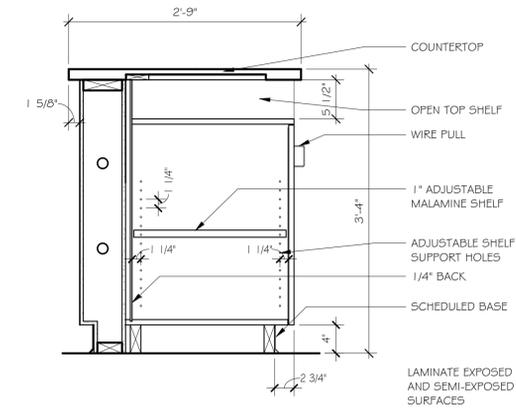

6 BASE SECTION WITH OPEN TOP SHELF
1" = 1'-0"

GENERAL INTERIOR ELEVATION NOTES


- A. PROVIDE FINISHED END PANELS ON EXPOSED ENDS OF CABINETS AND ON SUPPORT LEGS.
- B. PROVIDE FILLER PANELS FOR PROPER DOOR OPERATION AND DRAWER OPERATION AND AS REQUIRED FOR FINISHED CASEWORK.
- C. PROVIDE SEALANT AT COUNTERTOP AND WALL INTERSECTIONS, AT BACKSPASH AND WALL INTERSECTIONS, AND AT PLUMBING FIXTURES.
- D. PROVIDE 1 1/2" RADIUS ON EXPOSED COUNTERTOP CORNERS.
- E. CASEWORK SECTIONS ARE INDICATED ON SHEET A12.1.
- F. MOUNT OUTLETS 10" ABOVE COUNTER TO TOP OF BOX UNLESS NOTED OTHERWISE.
- G. LAMINATE ALL EXPOSED AND SEMI-EXPOSED SURFACES OF CASEWORK AND COUNTERTOPS.
- H. SEE FINISH SCHEDULE ON A15.1 FOR SPECIFIC FINISHES.
- I. ALL CASEWORK TO FOLLOW AWI STANDARDS.

FLOYD COUNTY
ANNEX
RENOVATION 2ND
& 3RD FLOORS 120
W. SPRING

NEW ALBANY INDIANA


INTERIOR ELEVATIONS

REVISIONS



LMH ARCHITECTURE
ARCHITECTURE + MAP ARCHITECTS
12808 TOWNPARK WAY, SUITE 200
LOUISVILLE, KY 40243
502.581.0570
WWW.LMHARCHITECTURE.COM


PROJECT NUMBER	FCI2501
DATE	JUNE 12, 2025
SHEET NUMBER	A11.1

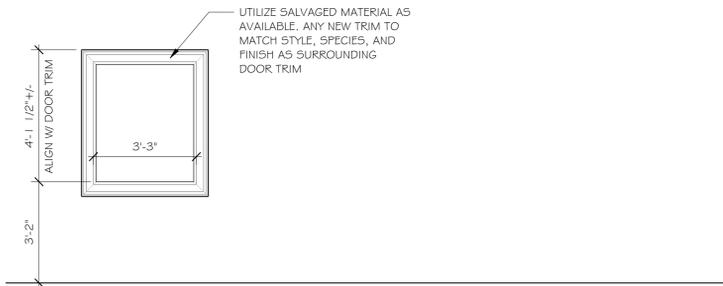

A **B**

WINDOW TYPE LEGEND


SCALE: 3/8" = 1'-0"

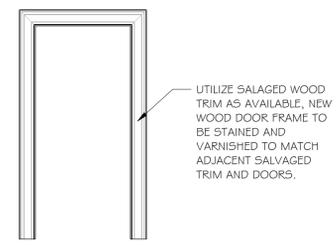

1

DOOR FRAME ELEVATIONS

SCALE: 3/8" = 1'-0"



A

DOOR TYPES

SCALE: 3/8" = 1'-0"

DOOR SCHEDULE															
DOOR NUMBER	ROOM NAME	ROOM NUMBER	PAIR	Width	Height	DOOR				FRAME			HARDWARE	SALVAGED DOOR #	REMARKS
						MATERIAL	FINISH	THICKNESS	TYPE	MATERIAL	FINISH	ELEVATION			
200	STAIR	A		3' - 0"	7' - 11"	-	-	0' - 1 3/4"	-	-	-	-	1		EXISTING TO REMAIN WITH NEW HARDWARE
201	ELEVATOR LOBBY	200		3' - 0"	7' - 0"	SCW	S4V	0' - 1 3/4"	A	WOOD	S4V	J	2	103	REUSE SALVAGED DOOR INCLUDING SALVAGED BORROWED LITE
203	ELEVATOR LOBBY	200		3' - 0"	7' - 0"	-	-	0' - 1 3/4"	-	-	-	-	2		EXISTING TO REMAIN WITH NEW HARDWARE
205	SHARED MEETING	205		3' - 0"	7' - 0"	SCW	S4V	0' - 1 3/4"	A	WOOD	S4V	J	2	104	REUSE SALVAGED DOOR
209	STAFF LOBBY	215		3' - 0"	7' - 0"	-	-	0' - 1 3/4"	-	-	-	-	2		EXISTING TO REMAIN WITH NEW HARDWARE
215	STAIR	B		3' - 0"	7' - 0"	-	-	0' - 1 3/4"	-	-	-	-	1		EXISTING TO REMAIN WITH NEW HARDWARE
217	HALL	217		3' - 0"	7' - 0"	-	-	0' - 1 3/4"	-	-	-	-	2		EXISTING TO REMAIN WITH NEW HARDWARE
218	AUDITOR	218		3' - 0"	7' - 0"	HCW	PAINT	0' - 1 3/8"	A	WOOD	S4V	J	6	101	POCKET DOOR REUSE SALVAGED DOOR
218A	SUPPLIES/ RECORDS	218A		3' - 0"	7' - 0"	SCW	-	0' - 1 3/4"	A	WOOD	S4V	J	3	102	REUSE SALVAGED DOOR
219	DEPUTY AUDITOR	219		3' - 0"	7' - 0"	SCW	-	0' - 1 3/4"	A	WOOD	S4V	J	4	105	REUSE SALVAGED DOOR INCLUDING SALVAGED BORROWED LITE
226	ELEVATOR LOBBY	200		3' - 0"	7' - 0"	-	-	0' - 1 3/4"	-	-	-	-	2		EXISTING TO REMAIN WITH NEW HARDWARE
300	ELEVATOR LOBBY	300	YES	6' - 0"	7' - 0"	-	-	0' - 1 3/4"	-	-	-	-	5		EXISTING TO REMAIN WITH NEW HARDWARE
301	STAIR	A		3' - 0"	7' - 0"	-	-	0' - 1 3/4"	-	-	-	-	1		EXISTING TO REMAIN WITH NEW HARDWARE
315	STAIR	B		3' - 0"	7' - 0"	-	-	0' - 1 3/4"	-	-	-	-	1		EXISTING TO REMAIN WITH NEW HARDWARE
315A	STAFF LOBBY	315		3' - 0"	7' - 0"	-	-	0' - 1 3/4"	-	-	-	-	2		EXISTING TO REMAIN WITH NEW HARDWARE

SEE DEMOLITION PLANS FOR SALVAGED DOOR NUMBER REFERENCE

CONTRACTOR TO HAVE ALL EXISTING UNLABELED DOORS AND FRAMES IN 2-HOUR MINIMUM RATED STAIR WALL VERIFIED AND PROVIDE NEW 90 MINUTE LABELS ON ALL THAT DO NOT HAVE TAG / LABEL VISIBLE.

- DOOR HARDWARE**
- CONTRACTOR SHALL FIELD VERIFY ALL EXISTING HARDWARE PREPS AND MATCH EXISTING PRIOR TO ORDERING.
 - ALL HARDWARE SHALL BE SUPPLIED TO CONFORM TO APPLICABLE STATE, LOCAL AND NATIONAL CODES IN ACCORDANCE WITH THE AHJ.
 - FURNISH ALL BRACKETS REQUIRED FOR PROPER INSTALLATION.
 - FURNISH DOOR CLOSERS ON ALL FIRE AND SMOKE-RATED OPENINGS AS REQUIRED BY THE AHJ AND CODES.
 - FURNISH SMOKE AND FIRE SEALS ON ALL FIRE AND SMOKE-RATED OPENINGS AS REQUIRED BY THE A.H.J. AND CODES.
 - ALL HARDWARE SHALL BE GRADE 1 WITH BHMA 652 FINISH.
 - VERIFY ALL EXISTING HARDWARE IS IN WORKING ORDER. REPAIR ITEMS THAT ARE NON-COMPLIANT. CONTRACTOR SHALL CONFIRM ALL FUNCTIONS WITH OWNER PRIOR TO ORDERING HARDWARE. DOOR HARDWARE SHALL BE PROVIDED AS A COMPLETE FUNCTIONING OPENING WITH THE INTENDED FUNCTION OF THE OWNER.
 - ACCESS CONTROL CONTRACTOR RESPONSIBLE FOR SYSTEM REQUIREMENTS TO MEET APPLICABLE EGRESS CODE SECTIONS INCLUDING 1008.1.9.11 STAIRWAY DOORS.

- SET #1**
1EA LOCK
1EA LEVER
NEW HARDWARE BY ACCESS CONTROL CONTRACTOR
- SET #2**
3EA HINGES
1EA LOCK
1EA LEVER
NEW HARDWARE BY ACCESS CONTROL CONTRACTOR
- SET #3**
3EA HINGES - REUSE EXISTING
1EA LOCK
1EA WALL STOP
1EA LEVER
- SET #4**
3EA HINGES - BALL BEARING
1EA LOCK
1EA WALL STOP
1EA LEVER
- SET #5**
3EA HINGES - REUSE EXISTING
1EA LOCK
1 EA LEVER - REUSE EXISTING
- SET #6**
1EA COMMERCIAL GRADE TRACK
2EA BALL BEARING DOOR HANGERS
1EA DOOR BUMPER
1EA DOOR GUIDE
1EA POCKET DOOR LOCK


FLOYD COUNTY
ANNEX
RENOVATION 2ND
& 3RD FLOORS 120
W. SPRING

NEW ALBANY INDIANA

DOOR SCHEDULE AND
DETAILS

REVISIONS

2 ADDENDUM #2 07.07.25



LMH ARCHITECTURE
ARCHITECTURE + MAP ARCHITECTS
12808 TOWNPARK WAY, SUITE 200
LOUISVILLE, KY 40243
502.581.0570
WWW.LMHARCHITECTURE.COM

PROJECT NUMBER
FCI2501

DATE
JUNE 12, 2025

SHEET NUMBER
A14.1

INTERIOR FINISH LEGEND - TABLE							
FINISH CODE	DESCRIPTION	MANUFACTURER	PRODUCT	NUMBER	COLOR	FINISH/SIZE	NOTES
BASE							
RB-1	RUBBER BASE	JOHNSONITE	DURACOVE TRADITIONAL WALL BASE	--	MATCH TO EXISTING	4'	2ND FLOOR EAST
RB-2	RUBBER BASE	JOHNSONITE	DURACOVE TRADITIONAL WALL BASE	DC40	BLACK	4'	2ND FLOOR WEST
WDB-1	WOOD BASE	--	--	--	S4V-1	MATCH EXISTING PROFILE, SPECIES, AND CUT	
CASEWORK							
PL-1	PLASTIC LAMINATE	WILSONART	STANDARD LAMINATE	--	--	FINE VELVET	VERTICAL SURFACES
PL-2	PLASTIC LAMINATE	WILSONART	STANDARD LAMINATE	--	--	FINE VELVET	HORIZONTAL SURFACES
S4V	STAIN AND VARNISH	--	--	--	MATCH TO EXISTING	MATCH TO EXISTING	
CEILING							
ACT-1	ACOUSTICAL CEILING TILE	USG	RADAR	--	WHITE	MATCH TO EXISTING	CONTRACTOR TO VERIFY MATCH TO EXIST 2ND & 4TH FLOOR
ACT-2	ACOUSTICAL CEILING TILE	CERTAINTED	CASHMERE STYLE EDGE	CMTS-124	MATCH TO EXISTING	TIER NARROW REVEAL 24"X24"	3RD FLOOR
PT-5	PAINT	SHERWIN WILLIAMS	PROMAR 200 ZERO VOC	--	CEILING WHITE	EG-SHEL	UNDERSIDE OF BULKHEAD
FLOORING							
CPT-1	CARPET	PATCRAFT	FUTURA	10380	MATCH TO EXISTING	24" X 24"	2ND FLOOR
CPT-2	CARPET	INTERFACE	GREAT LENGTHS II		ENTROBEAN II	1MX1M	3RD FLOOR (DISCONTINUED)
CPT-5	CARPET	PATCRAFT	EXPERIENCE	10291	MATCH TO EXISTING	24" X 24"	STAIRWELL
LVT-1	LUXURY VINYL TILE PLANKS	TEKNOFLOR	RARE PLANK HPD	89003RP	AMERICAN WALNUT (MATCH EXISTING DOOR STAIN)	7.09" X 47.24", 3MM THICKNESS, 20 MIL WEAR LAYER	20 YR. WARRANTY (MIN) INSTALLATION METHOD: RANDOM STAGGER
LVT-2	LUXURY VINYL TILE PLANKS	TBD				3MM THICKNESS, 20 MIL WEAR LAYER	20 YR. WARRANTY (MIN) INSTALLATION METHOD: RANDOM STAGGER
TILE							
T-1	TILE - FLOOR	--	--	--	--	--	EXISTING TO REMAIN
WALL							
PT-1	PAINT	SHERWIN WILLIAMS	PROMAR 200 ZERO VOC	--	MATCH TO EXISTING	EG-SHEL	PAINT ENTIRE EXTENT OF WALLS TO EACH ADJACENT INSIDE CORNER
PT-2	PAINT	SHERWIN WILLIAMS	PROMAR 200 ZERO VOC	--	MATCH TO EXISTING	EG-SHEL	PAINT ENTIRE EXTENT OF WALLS TO EACH ADJACENT INSIDE CORNER





ALL MATERIAL SUBSTITUTIONS SUBJECT TO SPECIFICATION SECTION 01 6005

GENERAL FINISH SCHEDULE NOTES

- PATCH AND REPAINT TO MATCH EXISTING WALL CORNER TO CORNER IN ROOMS WHERE WORK IS BEING COMPLETED BUT EXISTING FINISHES TO REMAIN.
- IN ROOMS WITH NO WORK BEING COMPLETED EXISTING FINISHES TO REMAIN. PROTECT DURING CONSTRUCTION TO ADJACENT AREAS.
- ALL ELECTRICAL DEVICES AND COVERS TO MATCH EXISTING.
- USE MANUFACTURER'S RECOMMENDED INSTALLATION METHODS AND MATERIALS FOR ALL FINISHES

FLOORING TRANSITIONS

NOTE: MATCH COLOR OF FLOORING TRANSITION STRIP TO COLOR OF NEW FLOORING MATERIAL

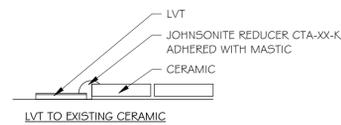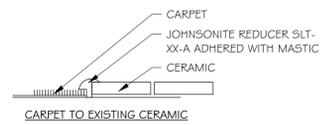

Room Schedule									
NO	ROOM NAME	FLOOR FINISH	BASE TYPE	BASE FINISH	WALL MATERIAL	WALL FINISH	CEILING TYPE	COMMENTS	
A	STAIR	ETR	ETR	ETR	ETR	ETR	ETR		
B	STAIR	ETR	ETR	ETR	ETR	ETR	ETR		
C	ELEVATOR	ETR	ETR	ETR	ETR	ETR	ETR		
2ND FLOOR									
200	ELEVATOR LOBBY	ETR	ETR	ETR	ETR	PAINT	ETR		
201	PUBLIC LOBBY	LVT-1	WOOD	S4V	DRYWALL	PAINT	ACT / DW		
202	SUPPLIES/ RECORDS	ETR	ETR	ETR	ETR	PAINT	ETR		
203	TREASURER STAFF	CPT-1	WOOD	S4V	DRYWALL	PAINT	ACT		
204	DEPUTY TREASURER	CPT-1	WOOD	S4V	DRYWALL	PAINT	ACT	PROTECT EXISTING FINISHES DURING CONSTRUCTION AND PATCH AS REQUIRED	
205	SHARED MEETING	ETR	ETR	ETR	ETR	PAINT	ETR	PROTECT EXISTING FINISHES DURING CONSTRUCTION AND PATCH AS REQUIRED	
206	TREASURER	CPT-1	WOOD	S4V	DRYWALL	PAINT	ACT	PROTECT EXISTING FINISHES DURING CONSTRUCTION AND PATCH AS REQUIRED	
207	WORK AREA	ETR	ETR	ETR	ETR	PAINT	ETR		
208	RESERVED	ETR	ETR	ETR	ETR	PAINT	ETR		
209	HALL	ETR	ETR	ETR	ETR	PAINT	ETR	PROTECT EXISTING FINISHES DURING CONSTRUCTION AND PATCH AS REQUIRED	
210	RESERVED	ETR	ETR	ETR	ETR	PAINT	ETR		
211	L.T.	ETR	ETR	ETR	ETR	PAINT	ETR		
212	JANITOR	ETR	ETR	ETR	ETR	PAINT	ETR		
213	MEN'S	ETR	ETR	ETR	ETR	PAINT	ETR		
214	WOMEN'S	ETR	ETR	ETR	ETR	PAINT	ETR		
215	STAFF LOBBY	ETR	ETR	ETR	ETR	PAINT	ETR		
216	PAYROLL CLERK	ETR	ETR	ETR	ETR	PAINT	ETR		
217	HALL	ETR	ETR	ETR	ETR	PAINT	ETR	PROTECT EXISTING FINISHES DURING CONSTRUCTION AND PATCH AS REQUIRED	
218	AUDITOR	CPT-1	WOOD	S4V	DRYWALL	PAINT	ACT	PROTECT EXISTING FINISHES DURING CONSTRUCTION AND PATCH AS REQUIRED	
218A	SUPPLIES/ RECORDS	ETR	ETR	ETR	ETR	PAINT	ETR		
219	DEPUTY AUDITOR	CPT-1	WOOD	S4V	DRYWALL	PAINT	ACT	PROTECT EXISTING FINISHES DURING CONSTRUCTION AND PATCH AS REQUIRED	
220	STORAGE	ETR	ETR	ETR	ETR	PAINT	ETR		
221	AP CLERK	ETR	ETR	ETR	ETR	PAINT	ETR		
222	WORK AREA	ETR	ETR	ETR	ETR	PAINT	ETR		
223	TAX MANAGER	ETR	ETR	ETR	ETR	PAINT	ETR	PROTECT EXISTING FINISHES DURING CONSTRUCTION AND PATCH AS REQUIRED	
224	MECHANICAL / I.T.	ETR	ETR	ETR	ETR	PAINT	ETR		
225	ELECTRICAL	ETR	ETR	ETR	ETR	PAINT	ETR		
226	AUDITOR STAFF	CPT-1	WOOD	S4V	DRYWALL	PAINT	ACT		
3RD FLOOR									
300	ELEVATOR LOBBY	ETR	ETR	ETR	ETR	ETR	ETR		
301	LOBBY	ETR	ETR	ETR	ETR	ETR	ETR		
302	SUPPLIES	ETR	ETR	ETR	ETR	ETR	ETR		
303	EXECUTIVE ASSISTANT	ETR	ETR	ETR	ETR	ETR	ETR		
304	HUMAN RESOURCES	ETR	ETR	ETR	ETR	ETR	ETR		
305	RESERVED	ETR	ETR	ETR	ETR	ETR	ETR		
306	COMMISSIONERS/ COUNCIL SHARED	ETR	ETR	ETR	ETR	ETR	ETR		
307	RESTROOM	ETR	ETR	ETR	ETR	ETR	ETR		
308	COFFEE	ETR	ETR	ETR	ETR	ETR	ETR		
309	SHARED MEETING	ETR	ETR	ETR	ETR	ETR	ETR		
310	L.T.	ETR	ETR	ETR	ETR	ETR	ETR		
311	MECHANICAL	ETR	ETR	ETR	ETR	ETR	ETR		
312	SUPPLIES	ETR	ETR	ETR	ETR	ETR	ETR		
313	RESERVED	ETR	ETR	ETR	ETR	ETR	ETR		
314	STORAGE	ETR	ETR	ETR	ETR	ETR	ETR		
315	STAFF LOBBY	ETR	ETR	ETR	ETR	ETR	ETR		
316	RESTROOM	ETR	ETR	ETR	ETR	ETR	ETR		
317	RESTROOM	ETR	ETR	ETR	ETR	ETR	ETR		
318	CORRIDOR	ETR	ETR	ETR	ETR	ETR	ETR		
319	RESERVED	ETR	ETR	ETR	ETR	ETR	ETR		
320	RESERVED	ETR	ETR	ETR	ETR	ETR	ETR		
321	RESERVED	ETR	ETR	ETR	ETR	ETR	ETR		
322	RESERVED	ETR	ETR	ETR	ETR	ETR	ETR		
323	RESERVED	ETR	ETR	ETR	ETR	ETR	ETR		
324	RESERVED	ETR	ETR	ETR	ETR	ETR	ETR		


FLOYD COUNTY
ANNEX
RENOVATION 2ND
& 3RD FLOORS 120
W. SPRING

NEW ALBANY INDIANA

ROOM FINISH SCHEDULE

REVISIONS

2 ADDENDUM #2 07.07.25



LMH ARCHITECTURE
ARCHITECTURE + MAP ARCHITECTS
12808 TOWNPARK WAY, SUITE 200
LOUISVILLE, KY 40243
502.581.0570
WWW.LMHARCHITECTURE.COM

PROJECT NUMBER

FCI2501

DATE

JUNE 12, 2025

SHEET NUMBER

A15.1

HEATING LEGEND

SYMBOL	DESCRIPTION
	TO BE REMOVED
	NEW CONNECTION TO EXISTING
	EXISTING EQUIPMENT
	NEW EQUIPMENT

ABBREVIATIONS

AC	AIR COMPRESSOR
BTUH	BRITISH THERMAL UNITS PER HOUR
CA	COMPRESSED AIR
CFM	CUBIC FEET PER MINUTE
CHWS	CHILLED WATER SUPPLY
CHWR	CHILLED WATER RETURN
DDC	DIRECT DIGITAL CONTROLS
DP	DIFFERENTIAL PRESSURE
FCU	FAN COIL UNIT
F.L.P	FAIL LAST POSITION
HWR	HOT WATER RETURN
HWS	HOT WATER SUPPLY
LPS	LOW PRESSURE STEAM
MBH	THOUSAND BTUH
MIN	MINIMUM
SA	SUPPLY AIR
STM	STEAM
TEMP	TEMPERATURE
VFD	VARIABLE FREQUENCY DRIVE

SYMBOL	DESCRIPTION
	HOT WATER SUPPLY
	HOT WATER RETURN
	CHILLED WATER SUPPLY
	CHILLED WATER RETURN
	HOT WATER PERIMETER SUPPLY
	HOT WATER PERIMETER RETURN
	CONDENSATE PUMP DISCHARGE
	ELBOW DOWN OR AWAY
	ELBOW UP OR TOWARD
	TEE DOWN OR AWAY
	TEE UP OR TOWARD
	RISE OR DROP
	90° ELBOW
	PIPE TEE
	PIPE TAKEOFF (FROM BOTTOM OF MAIN)
	PIPE TAKEOFF (FROM TOP OF MAIN)
	45° ELBOW
	BALL VALVE
	BUTTERFLY VALVE
	CHECK VALVE
	SOLENOID
	REDUCER
	CONCENTRIC REDUCER
	ECCENTRIC REDUCER
	AIR HANDLING UNIT
	BRANCH DUCT TAP
	RECTANGULAR DUCT (FIRST FIGURE IS SIDE SHOWN) ALL DUCT DIMENSIONS ARE INSIDE CLEAR DIMENSIONS
	SUPPLY DUCT UP OR TOWARD
	SUPPLY DUCT DOWN OR AWAY
	RETURN DUCT UP OR TOWARD
	RETURN DUCT DOWN OR AWAY
	EXHAUST DUCT UP OR TOWARD
	EXHAUST DUCT DOWN OR AWAY
	LAY-IN SUPPLY DIFFUSER WITH CFM
	LAY-IN RETURN GRILLE WITH CFM
	LAY-IN EXHAUST GRILLE WITH CFM
	DUCT-MOUNTED SUPPLY DIFFUSER WITH CFM

SITE/PROJECT SPECIFIC REQUIREMENTS

- EXISTING FINISHES - CONTRACTOR SHALL PROTECT ALL EXISTING FINISHED SURFACES (FLOORS, WALLS, CEILINGS, STEPS, RAILINGS, FURNISHINGS, ETC.) FROM DAMAGE DURING THE PROJECT. CONTRACT SHALL PAY ALL COSTS INCURRED TO REPAIR OR REPLACE COMPONENTS DAMAGED AS A RESULT OF WORK DONE FOR THE PROJECT.
- TEMPORARY REMOVAL OF COMPONENTS - CONTRACTOR MAY TEMPORARILY REMOVE EXISTING DOORS, RAILINGS, FURNISHINGS, ETC. WHILE LOADING AND UNLOADING EQUIPMENT. CONTRACTOR SHALL STORE AND PROTECT ANY ITEMS FROM DAMAGE. CONTRACTOR SHALL PROMPTLY REINSTALL OR REPLACE ANY REMOVED COMPONENTS ONCE ADDITIONAL CLEARANCE IS NOT NEEDED.
- CONTRACTOR SHALL TEMPORARILY REMOVE EXISTING CEILING-MOUNTED EQUIPMENT AS NEEDED TO PERFORM WORK. REMOVED ITEMS SHALL BE SAVED AND REINSTALLED PRIOR TO COMPLETION OF PROJECT.

GENERAL HVAC DEMOLITION NOTES

- VERIFY EXACT SIZE AND LOCATION OF EXISTING UTILITIES PRIOR TO START OF DEMOLITION
- UNLESS OTHERWISE NOTED, REMOVAL OF PIPING AND/OR EQUIPMENT SHALL INCLUDE ALL INSULATION, VALVES, HANGERS, SUPPORTS, EQUIPMENT PADS, FLASHING, ROOF CURBS, CONTROLS, AND ASSOCIATED VALVES, FITTINGS AND ACCESSORIES.
- UNLESS OTHERWISE NOTED, REMOVAL OF PIPING SHALL BE BACK TO THE MAIN OR LAST ACTIVE SERVICE. REMAINING PIPE SHALL BE CAPPED.
- ALL OPENINGS OR HOLES LEFT IN EXISTING WALLS, FLOORS, AND CEILINGS TO REMAIN, INCLUDES CHASES, SHALL BE PATCHED TO MATCH EXISTING CONDITIONS BY THE CONTRACTOR WHOSE WORK HAS CREATED THE OPENING OR HOLE.
- EXISTING CONDITIONS WERE OBTAINED THROUGH FIELD OBSERVATION AND AVAILABLE DRAWINGS.
- DISCONNECT ALL HEATING PIPING CONNECTIONS AND DUCTWORK CONNECTIONS TO EQUIPMENT BEING REMOVED.
- REMOVAL OF CONTROLS SHALL INCLUDE ALL WIRING BACK TO SOURCE INCLUDING ANY SUPPORTS, BOXES, CONDUITS AND ACCESSORIES.
- REMOVAL OF PNEUMATIC CONTROLS SHALL INCLUDE ALL PNEUMATIC TUBING AND ACCESSORIES. REMOVE PIPING AND CAP AT LAST ACTIVE SOURCE.
- DISCONNECT ALL DUCTWORK CONNECTIONS TO EQUIPMENT BEING REMOVED.

GENERAL HVAC NOTES

- DUCTWORK AND PIPING IS SHOWN IN SCHEMATIC FORM ONLY, OFFSETS AND CHANGES IN ELEVATIONS ARE NOT NECESSARILY SHOWN. ROUTE DUCTWORK IN AN ORDERLY MANNER AS REQUIRED FOR CLEARANCE WITH STRUCTURAL CONDITIONS. COORDINATE LOCATION OF DUCTWORK WITH OTHER TRADES PRIOR TO INSTALLATION.
- COORDINATE LOCATIONS AND SIZES OF CONNECTIONS TO EQUIPMENT WITH ALL TRADES.
- CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ADEQUATE SUPPORTING SYSTEMS AND DEVICES FOR ALL DUCTWORK, PIPING, HVAC EQUIPMENT, AND ACCESSORIES.
- PROVIDE AND INSTALL SLEEVES FOR ALL DUCTWORK AND PIPING PASSING THROUGH WALLS AND FLOORS.
- PROVIDE RIGID METAL DUCT, WITH NO EXCEPTION, WHERE FIRE AND/OR SMOKE RATED WALLS, CEILINGS, AND FLOORS ARE PENETRATED.
- LOCATE AND INSTALL ALL HVAC EQUIPMENT TO PROVIDE MANUFACTURER'S MINIMUM SERVICE CLEARANCES.
- CONNECTIONS TO EQUIPMENT SHALL BE PROVIDED WITH ISOLATION VALVES AND UNIONS TO FACILITATE EQUIPMENT REMOVAL.
- PIPING IS SHOWN IN SCHEMATIC FOR ONLY, CHANGES IN ELEVATION ARE NOT NECESSARILY SHOWN. ROUTE PIPING IN AN ORDERLY MANNER AS REQUIRED FOR CLEARANCE WITH STRUCTURAL CONDITIONS. COORDINATE LOCATION OF PIPING WITH OTHER TRADES PRIOR TO INSTALLATION. WHERE POSSIBLE, RACK PIPING HORIZONTALLY OR VERTICALLY.
- SEE HEATING DETAILS FOR EXACT PIPING CONNECTIONS TO EQUIPMENT, INCLUDING VALVES, TRAPS, AND SYSTEM ACCESSORIES.
- BALANCING VALVES SHALL BE, AT MINIMUM, ONE PIPE SIZE SMALLER THAN THE PIPING IN WHICH THEY ARE INSTALLED. CONTRACTOR SHALL VERIFY THAT VALVE CAN BE ADJUSTED TO MEET FLOW REQUIREMENTS WITHOUT THE PRODUCTION OF UNACCEPTABLE NOISE.
- THE LOCATIONS AND SIZES OF EXISTING DUCTWORK, PIPING, AND EQUIPMENT HAS BEEN TAKEN FROM "AS-BUILT" DRAWINGS AND INFORMATION PROVIDED BY THE OWNER. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO START OF WORK.
- ALL CONNECTIONS TO, OR SHUTDOWNS OF, EXISTING SYSTEMS SHALL BE COORDINATED WITH THE OWNER TO PROVIDE MINIMUM INTERFERENCE WITH THEIR OPERATION AND DOWNTIME OF THE SYSTEM.
- SEAL ALL PENETRATIONS OF FIRE AND SMOKE RATED WALLS, CEILINGS, AND FLOORS IN ACCORDANCE WITH THE PROJECT MANUAL. CORRIDOR WALLS THAT ARE BUILT TO DECK SHALL BE TREATED AS FIRE RATED WALLS.



PROJECT TITLE
E07825001 ENVOY - FLOYD
COUNTY ANNEX
RENOVATION


DESIGNED BY:	ARW
DRAWN BY:	ARW
CHECKED BY:	NTP
DATE CHECKED:	05/16/25

DATE	REVISION
07/03/25	ADDENDUM #1

DRAWING TITLE
MECHANICAL GENERAL
NOTES LEGEND AND
ABBREVIATIONS


PROJECT No.
E07825001

DRAWING No.
H-0.01

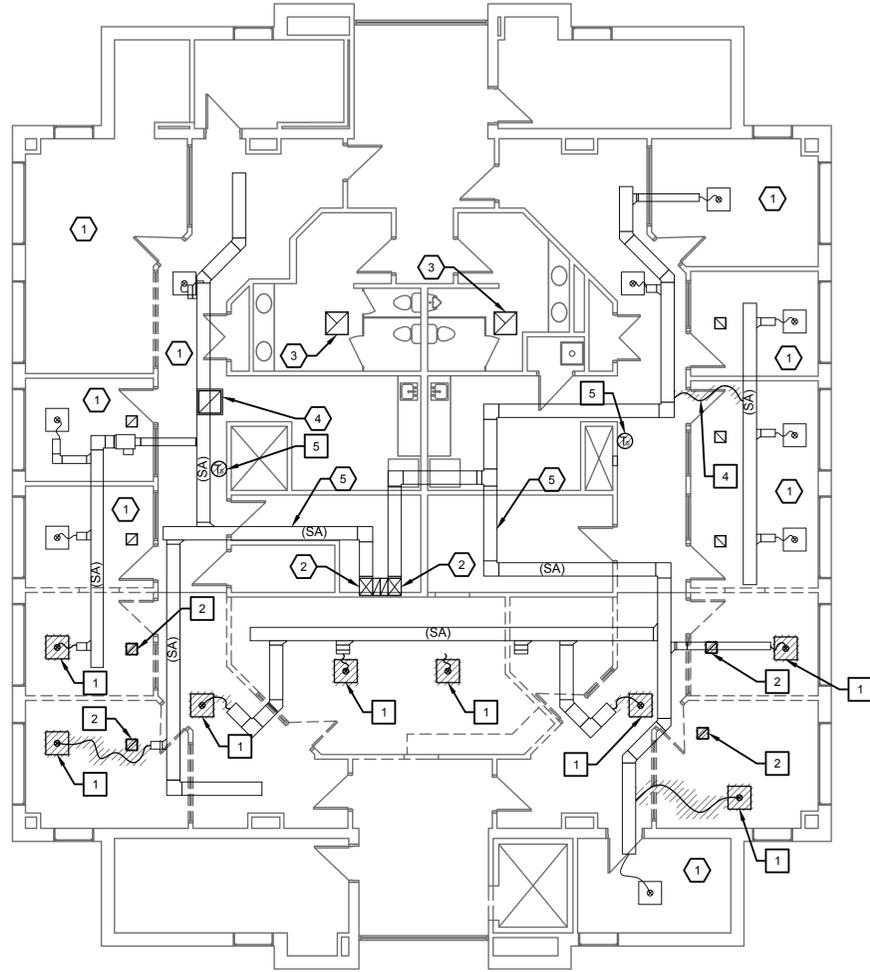

1 SECOND FLOOR MECHANICAL DEMO PLAN

0 2' 4' 8' 16'

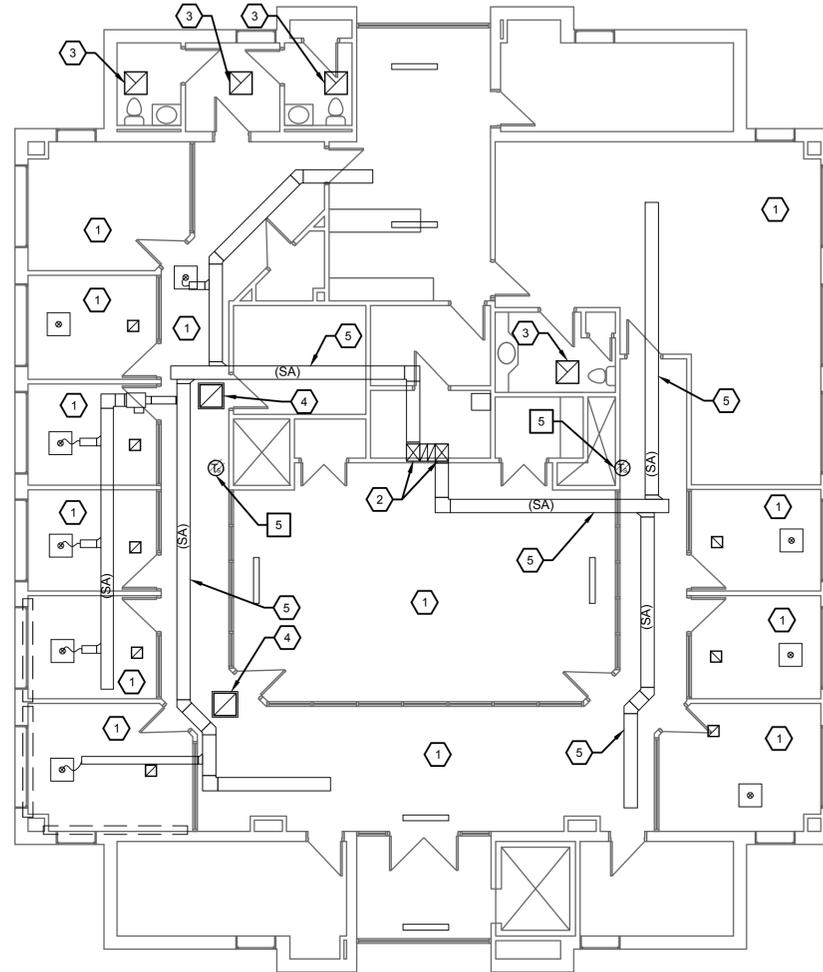

2 THIRD FLOOR MECHANICAL DEMO PLAN

0 2' 4' 8' 16'



NOTES (THIS SHEET)

1. SEE SHEET H-001 FOR SYMBOLS AND ABBREVIATIONS.

DEMOLITION KEYNOTES

1. REMOVE EXISTING SUPPLY DIFFUSER AND FLEX DUCTWORK.
2. REMOVE EXISTING RETURN GRILLE.
3. REMOVE EXISTING EXHAUST GRILLE. CAP EXISTING EXHAUST DUCTWORK.
4. REMOVE EXISTING FLEX DUCTWORK.
5. REMOVE EXISTING THERMOSTAT. THERMOSTAT TO BE RELOCATED. SEE H-2.01.

KEYNOTES (THIS SHEET)

1. EXISTING SUPPLY DIFFUSERS AND RETURN GRILLES TO REMAIN.
2. EXISTING 5 TON HEAT PUMP TO REMAIN.
3. EXISTING EXHAUST GRILLE TO REMAIN.
4. EXISTING RETURN GRILLE TO REMAIN.
5. EXISTING SUPPLY DUCTWORK ABOVE CEILING TO REMAIN.

PROJECT TITLE
**E07825001 ENVOY - FLOYD
 COUNTY ANNEX
 RENNOVATION**

DESIGNED BY: ARW
 DRAWN BY: ARW
 CHECKED BY: NTP
 DATE CHECKED: 05/16/25

07/03/25 ADDENDUM #1

DATE REVISION

DRAWING TITLE
**SECOND & THIRD FLOOR
 MECHANICAL DEMO PLAN**

PROJECT No.
E07825001

DRAWING No.
H-1.01

GRILLES & DIFFUSER SCHEDULE											
TAG	TYPE	FACE SIZE	AIR PATTERN	THROW (FEET)	MOUNTING	MATERIAL	FINISH	MAX N.C. LEVEL	NOTES	DESIGN BASIS	
										MANUFACTURER	MODEL NUMBER
SD-1	SQUARE PLAQUE CEILING DIFFUSER	24x24	4-WAY	VARIES	LAY-IN	ALUMINUM	WHITE	30		PRICE	SPD
RG-1	3/4" LOUVER GRILLE 45 DEGREE	24X24	-	-	LAY-IN	ALUMINUM	WHITE	30		PRICE	600

AIR INLET/OUTLET CONNECTION SCHEDULE				
SYMBOL	TAG	NECK SIZE	DUCT SIZE	REMARKS
A1	SD-1	6"	-	NOTES 1, 2
A2	SD-1	8"	-	NOTES 1, 2
B1	RG-1	-	-	NOTES 1, 2

NOTES

- UNLESS OTHERWISE NOTED, ALL BRANCH DUCTWORK TO AIR INLET/OUTLET SHALL EQUAL THE SCHEDULED NECK SIZE. PROVIDE TRANSITIONS AS REQUIRED.
- PROVIDE VOLUME DAMPER FOR EACH DIFFUSER.



FAN SCHEDULE													
TAG	SERVICE LOCATION	AIR VOL. (CFM)	EXT. S.P. (IN. W.C.)	MTR.SPEED (RPM)	MOTOR HP	DRIVE	FAN TYPE	ELECTRIC DATA			REMARKS	DESIGN BASIS	
								V	PH	HZ		MANUFACTURER	MODEL NUMBER
SF-1	OA INTAKE 2ND FLOOR	550	0.5	1725	1/6	DIRECT	INLINE	120	1	60	XX	GREENHECK	SQ-95
SF-2	OA INTAKE 3RD FLOOR	550	0.5	1725	1/6	DIRECT	INLINE	120	1	60	XX	GREENHECK	SQ-95

NOTES:

- XX




PROJECT TITLE
E07825001 ENVOY - FLOYD COUNTY ANNEX RENNOVATION

DATE	REVISION


DRAWING TITLE
MECHANICAL SCHEDULES

PROJECT No.
E07825001


DRAWING No.
H-4.01

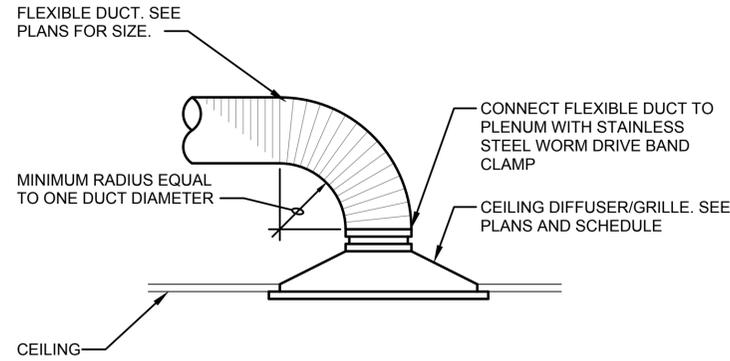


1 DIFFUSER/GRILLE CONNECTION
NO SCALE

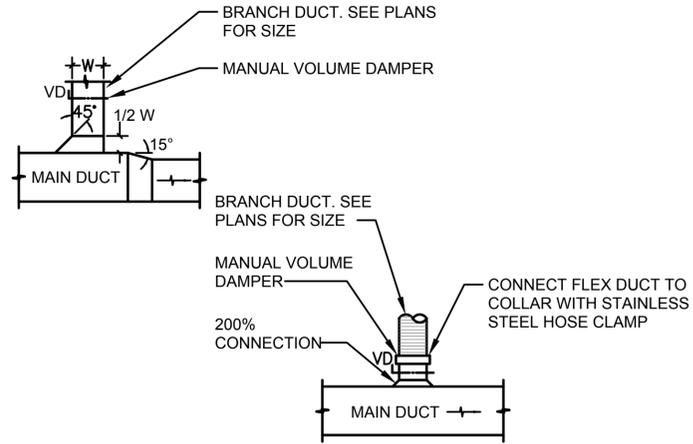

2 DUCT CONNECTIONS
NO SCALE

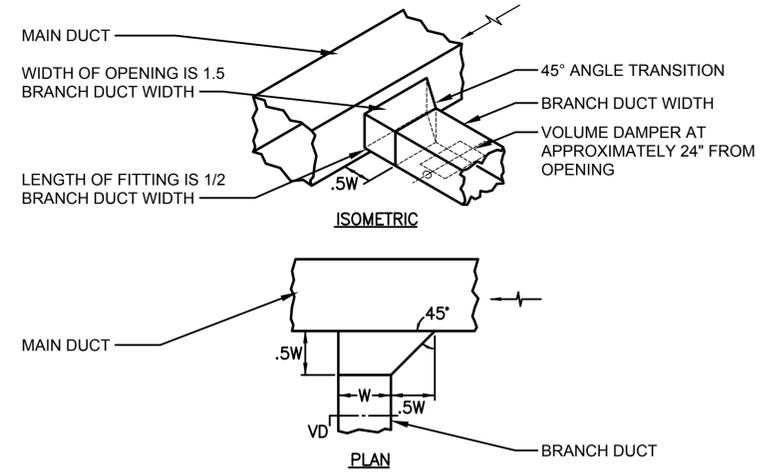

3 BRANCH TAKEOFF FITTING W/VD
NO SCALE

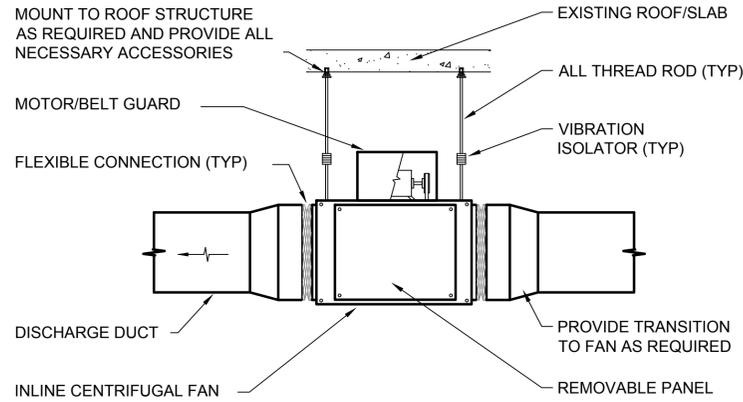

NOTE: SEE ARCHITECTURAL DRAWINGS FOR EXACT ROOF DETAILS

4 INLINE CENTRIFUGAL FAN INSTALLATION
NO SCALE

DATE	REVISION

ELECTRICAL GENERAL NOTES

- ALL WORK SHALL CONFORM TO THE 2020 NATIONAL ELECTRICAL CODE AND ALL APPLICABLE CODES, THE MOST CURRENT EDITION OF THE NATIONAL ELECTRICAL SAFETY CODE, AND ALL APPLICABLE LOCAL ORDINANCES.
- CONTRACTOR SHALL FURNISH ALL MATERIALS FOR A COMPLETE AND WORKABLE SYSTEM. ALL MATERIALS FURNISHED BY THE CONTRACTOR ARE TO BE NEW.
- CONTRACTOR SHALL COORDINATE AND SCHEDULE ALL OUTAGES OF POWER, FIRE ALARM, DATA AND TELEPHONE SERVICES WITH THE USING AGENCY. CONTRACTOR SHALL PROVIDE MINIMUM OF 2 WEEKS ADVANCE NOTICE PRIOR TO ANY OUTAGE.
- THE USING AGENCY SHALL HAVE "FIRST RIGHT OF REFUSAL" FOR ALL REMOVED ELECTRICAL EQUIPMENT (PANELS, BREAKERS, ETC..).
- CONTRACTOR IS RESPONSIBLE FOR DISPOSAL OF ALL MATERIALS REMOVED AS PART OF THIS PROJECT THAT THE USING AGENCY DOES NOT WANT TURNED OVER TO THEM. DISPOSAL SHALL BE IN ACCORDANCE WITH ALL APPLICABLE REGULATIONS. ALL DISPOSAL SHALL BE AT THE CONTRACTOR'S EXPENSE.
- ALL PANELBOARDS SHALL BE KEYED WITH A FAB-7 KEY.
- CONTRACTOR SHALL REMOVE ALL UNUSED CONDUIT AND WIRE BACK TO SOURCE. CONCEALED CONDUIT BELOW SLAB, UNDERGROUND, OR IN WALLS MAY REMAIN IN PLACE. UNUSED CONDUITS LOCATED ABOVE SUSPENDED CEILINGS SHALL BE CONSIDERED EXPOSED AND SHALL BE REMOVED.
- ALL EQUIPMENT SHOWN ON THE DRAWINGS IS NEW UNLESS OTHERWISE NOTED AS EXISTING OR RELOCATED.
- ALL CONDUIT PENETRATIONS SHALL BE THE MINIMUM SIZE REQUIRED FOR THE CONDUIT. ALL NEW OR EXISTING OPENINGS BEING USED FOR CONDUIT PENETRATIONS IN EXISTING WALLS, FLOORS AND CEILINGS NOT BEING DEMOLISHED, INCLUDING CHASES, SHALL BE SEALED WITH FIRE CAULK AND PATCHED TO MATCH EXISTING CONDITIONS BY THE CONTRACTOR WHOSE WORK HAS CREATED THE OPENING. IF LARGE HOLES ARE CREATED OR USED, THEN THEY SHALL BE SEALED WITH MASONRY. ALL HOLES IN WALLS WHERE ELECTRICAL EQUIPMENT IS BEING REMOVED (I.E. BOXES, SURFACE RACEWAY, CONDUIT, ETC.) SHALL BE PATCHED AND PAINTED OR HOLES FILLED WITH GROUT TO MATCH EXISTING CONDITIONS BY ELECTRICAL CONTRACTOR. EXISTING UNUSED OPENINGS DO NOT NEED TO BE REPAIRED.
- ALL INTERIOR CONDUIT SHALL BE EMT TYPE (3/4" MINIMUM UNLESS NOTED OTHERWISE). ALL CONDUIT IN TUNNELS AND OUTSIDE SHALL BE RIGID GALVANIZED STEEL.
- CONTRACTOR SHALL PROVIDE BLANK STAINLESS STEEL COVER PLATES FOR ALL UNUSED WALLBOXES.
- ALL INTERIOR SURFACE RACEWAY AND EXPOSED INTERIOR CONDUIT SHALL BE EMT TYPE CONDUIT UNLESS NOTED OTHERWISE.
- CONTRACTOR SHALL INDICATE ALL CORRECT CIRCUIT NUMBERS FOR ALL NEW OR MODIFIED LOADS (I.E. LIGHTING CIRCUITS, ADDED RECEPTACLES, MOTOR LOADS, ETC.) ON THE RECORD DRAWINGS.
- CONTRACTOR SHALL INCLUDE ALL PREMIUM TIME REQUIRED TO PERFORM OUTAGES AS CONVENIENT FOR THE USING AGENCY. NO ADDITIONAL COMPENSATION WILL BE ALLOWED FOR OUTAGES PERFORMED AT NIGHT, ON WEEKENDS OR ON HOLIDAYS.
- CONTRACTOR SHALL INCLUDE ALL PREMIUM TIME REQUIRED TO PERFORM ANY NOISY, DISRUPTIVE OR HAZARDOUS WORK. THIS WORK SHALL BE PERFORMED AFTER NORMAL HOURS OR ON WEEKENDS.
- ALL BRANCH CIRCUIT WIRING SHALL BE 2#12, 1#12G UNLESS NOTED OTHERWISE. UTILIZE EXISTING CONDUIT WHERE POSSIBLE.
- ALL ELECTRICAL DEVICES (SWITCHES, RECEPTACLES, ETC...) SHALL BE BROWN IN COLOR. ALL COVERPLATES SHALL BE STAINLESS STEEL TYPE.
- THERE HAS BEEN LEAD PAINT ENCOUNTERED IN SOME LOCATIONS WITHIN THE BUILDINGS. IF LEAD PAINT IS ENCOUNTERED THE CONTRACTOR SHALL HANDLE APPROPRIATELY PER SPEC SECTION 02 83 00.
- APPLICATION FOR BUILDING CREDENTIAL WILL BE PROVIDED BY THE USING AGENCY AND WILL NEED TO BE FILLED OUT BY THE CONTRACTOR AND RETURNED FOR BADGING PRIOR TO ANY WORK BEING PERFORMED.
- THE CONTRACTOR IS RESPONSIBLE FOR FOLLOWING ALL USING AGENCY PROCEDURES IDENTIFIED IN THE USING AGENCY'S FIRE ALARM SYSTEM DEVICE IMPAIRMENT NOTICE PROCEDURES.
- ONSITE PARKING IS NOT AVAILABLE FOR THE CONTRACTOR'S VEHICLES.
- ALL NEW RECEPTACLE COVERPLATES SHALL BE STAINLESS STEEL. PROVIDE AN ENGRAVED PLATE WITH THE PANEL AND CIRCUIT # FEEDING THE RECEPTACLE MOUNTED TO THE COVERPLATE.
- ALL NEW RECEPTACLES THAT ARE BEING FED FROM AN EMERGENCY PANEL SHALL BE RED IN COLOR.
- WHERE THE CONTRACTOR ABANDONS CONCEALED CONDUIT IN PLACE, THE CONTRACTOR SHALL PROVIDE A TAG AT EACH END INDICATING "ABANDONED CONDUIT". CONTRACTOR SHALL PLUG ALL CONDUITS THAT THEY ABANDON IN PLACE.

ELECTRICAL SYMBOL LIST

-  EXISTING PANELBOARD
-  FIRE ALARM SMOKE DETECTOR, CEILING MOUNTED
-  FIRE ALARM NOTIFICATION DEVICE
-  EQUIPMENT TO BE REMOVED
-  TYPICAL LIGHT FIXTURE DESIGNATION
-  INDICATES FIXTURE TYPE
-  LIGHT FIXTURE, RECESSED MOUNTED
-  EXIT SIGN, CEILING MOUNTED
-  LIGHT SWITCH, 1 POLE
-  LIGHT SWITCH, 3-WAY
-  CARD READER

ELECTRICAL ABBREVIATIONS

A	AMPERES	KV	KILO-VOLT
AC	ABOVE COUNTER	KVA	KILO-VOLT AMPERES
AFF	ABOVE FINISHED FLOOR	KW	KILOWATTS
ALUM	ALUMINIUM	LBS	POUNDS
ASPH	ASPHALT	MC	MECHANICAL CONTRACTOR
AWG	AMERICAN WIRE GAUGE	MCC	MOTOR CONTROL CENTER
C	CONDUIT	MCP	MOTOR CIRCUIT PROTECTOR
CKT	CIRCUIT	MFR	MANUFACTURER
CLG	CEILING	MLO	MAIN LUG ONLY
CONC	CONCRETE	MMS	MANUAL MOTOR STARTER
CONT	CONTINUED	MSWB	MAIN SWITCHBOARD
CSDS	COMBINATION STARTER/DISC. SW.	NB	NEUTRAL BUS
D	DEPTH	NW	NEUTRAL WINDING
DDC	DIRECT DIGITAL CONTROL	OC	OVERCURRENT
DN	DOWN	OL'S	OVERLOAD RELAYS
E	ELECTRIC	P	POLE, PUMP
EA	EACH	PH	PHASE
EBJ	EQUIPMENT BONDING JUMPER	PLC	PROGRAMMABLE LOGIC CONTROLLER
EC	ELECTRICAL CONTRACTOR	PRI	PRIMARY
ENC	ENCLOSURE	RGS	RIGID GALVANIZED STEEL
EM	EMERGENCY	RPM	REVOLUTIONS PER MINUTE
ETM	ELAPSED TIME METER	SBJ	SYSTEM BONDING JUMPER
FDR	FEEDER	SEC	SECONDARY
FLA	FULL LOAD AMPERES	SS	STAINLESS STEEL
FLUOR	FLUORESCENT	T	TELEPHONE
FVNR	FULL VOLTAGE NON-REVERSING	TSP	TWISTED SHIELDED PAIR
FVZS	FULL VOLTAGE 2-SPEED	TYP	TYPICAL
G,GND	GROUND	UL	UNDERWRITER'S LABORATORY
GB	GROUND BUS	UPS	UNINTERRUPTIBLE POWER SUPPLY
GC	GENERAL CONTRACTOR	V	VOLTS
GFI	GROUND FAULT INTERRUPTER	VA	VOLT AMPERES
HP	HORSEPOWER	VFD	VARIABLE FREQUENCY DRIVE
HRG	HIGH RESISTANCE GROUND	W	WATTS
I/O	INPUT/OUTPUT	WP	WEATHER PROOF
IN	INCHES	XFMR	TRANSFORMER


ClarkDietz
 DESIGN FIRM REGISTRATION NO. 184-000450
 125 W. CHURCH STREET
 CHAMPAIGN, IL 61820
 PHONE : 217-373-8900 www.clarkdietz.com

PROJECT TITLE
**E07825001 ENVOY - FLOYD
 COUNTY ANNEX
 RENNOVATION**

DRAWING TITLE
**ELECTRICAL GENERAL NOTES
 LEGEND AND ABBREVIATIONS**


PROJECT No.
E07825001

DRAWING No.
E-0.01

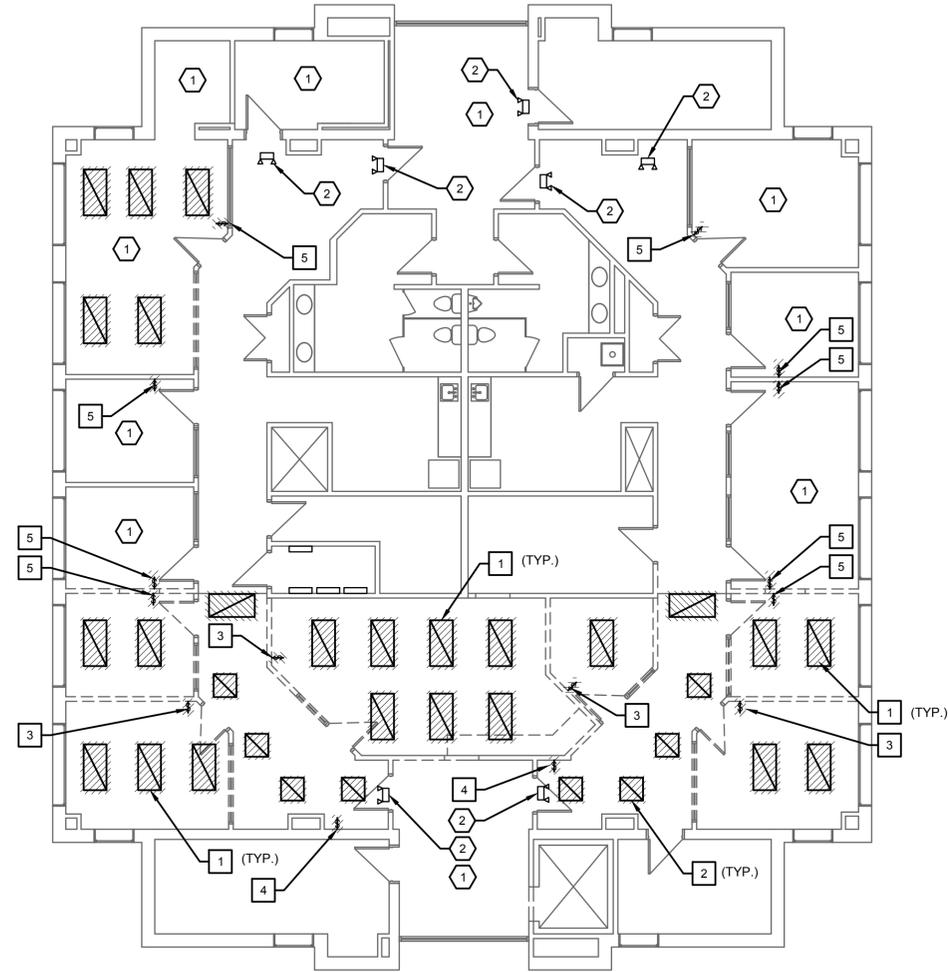

1 SECOND FLOOR LIGHTING DEMO PLAN

0 2' 4' 8' 16'

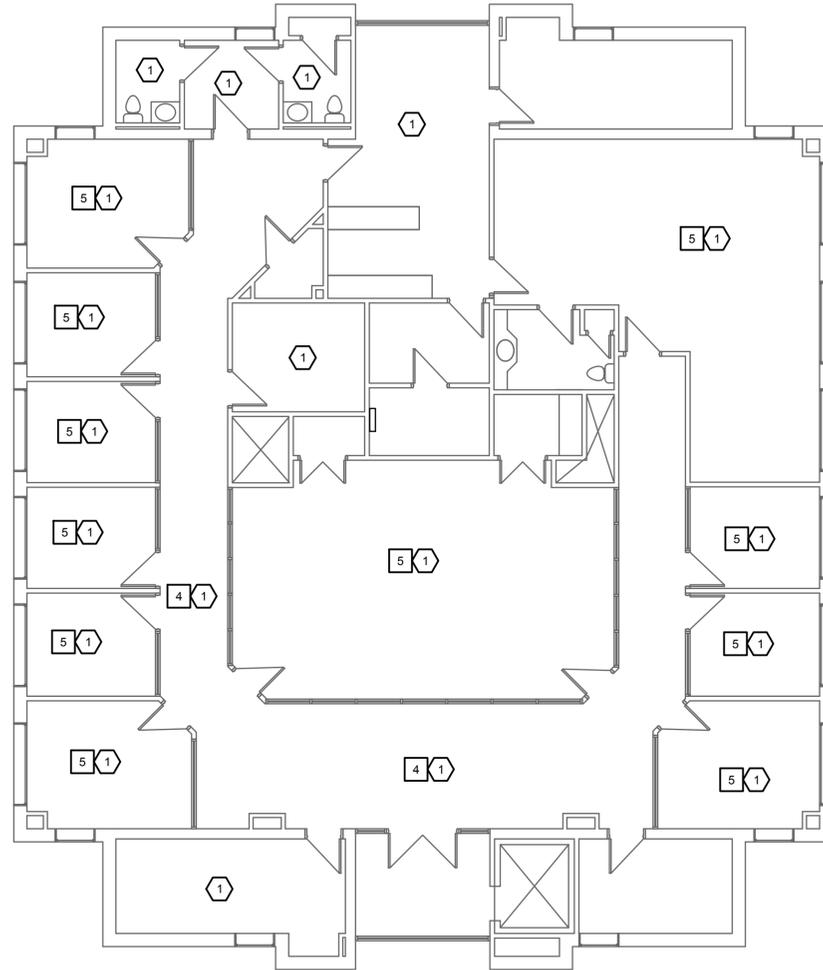

2 THIRD FLOOR LIGHTING DEMO PLAN

0 2' 4' 8' 16'

NOTES (THIS SHEET)

1. SEE SHEET E-0.01 FOR SYMBOLS AND ABBREVIATIONS.
2. ALL EXISTING ELECTRICAL DEVICES AND LIGHTS TO REMAIN UNLESS OTHERWISE NOTED. NOT ALL EXISTING ELECTRICAL DEVICES AND LIGHTS SHOWN.
3. ALL EXISTING CEILING MOUNTED DEVICES IN CEILINGS BEING REMOVED FOR CONSTRUCTION ARE TO BE REMOVED AND/OR PROTECTED DURING CONSTRUCTION, AND REINSTALLED AFTER CONSTRUCTION IS COMPLETED, UNLESS OTHERWISE NOTED.

DEMOLITION KEYNOTES

1. DISCONNECT AND REMOVE EXISTING 2'X4' FIXTURE. FIXTURE TO BE RELOCATED IN NEW CEILING GRID.
2. DISCONNECT AND REMOVE EXISTING 2'X2' FIXTURE.
3. DISCONNECT AND REMOVE EXISTING LIGHT SWITCH.
4. REMOVE EXISTING 3-WAY SWITCH. PROTECT EXISTING WIRING FOR USE WITH REPLACEMENT DIMMER SWITCHES. SEE SHEET E-2.01.
5. REMOVE EXISTING SINGLE POLE SWITCH. PROTECT EXISTING WIRING FOR USE WITH REPLACEMENT DIMMER SWITCH. SEE SHEET E-2.01.

KEYNOTES (THIS SHEET)

1. EXISTING LIGHTING AND CONTROLS IN THIS AREA TO REMAIN.
2. EXISTING LIGHTING IN THIS AREA TO REMAIN.
3. EXISTING COMBO EXIT EMERGENCY LIGHT TO REMAIN.

PROJECT TITLE
**E07825001 ENVOY - FLOYD
 COUNTY ANNEX
 RENNOVATION**


DESIGNED BY: ARW
 DRAWN BY: ARW
 CHECKED BY: NTP
 DATE CHECKED: 05/16/25

DATE	REVISION
07/03/25	ADDENDUM #1

DRAWING TITLE
**SECOND & THIRD FLOOR
 LIGHTING DEMO PLAN**


PROJECT No.
E07825001

DRAWING No.
E-1.01

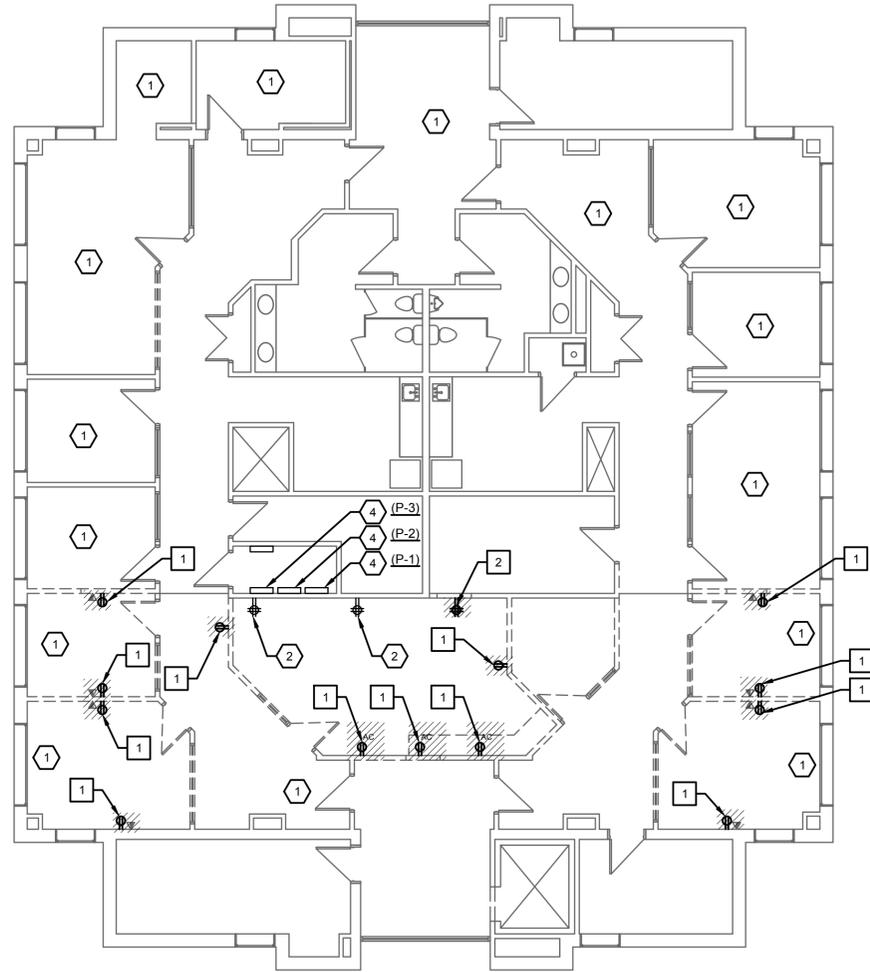

1 SECOND FLOOR POWER DEMO PLAN

0 2' 4' 8' 16'

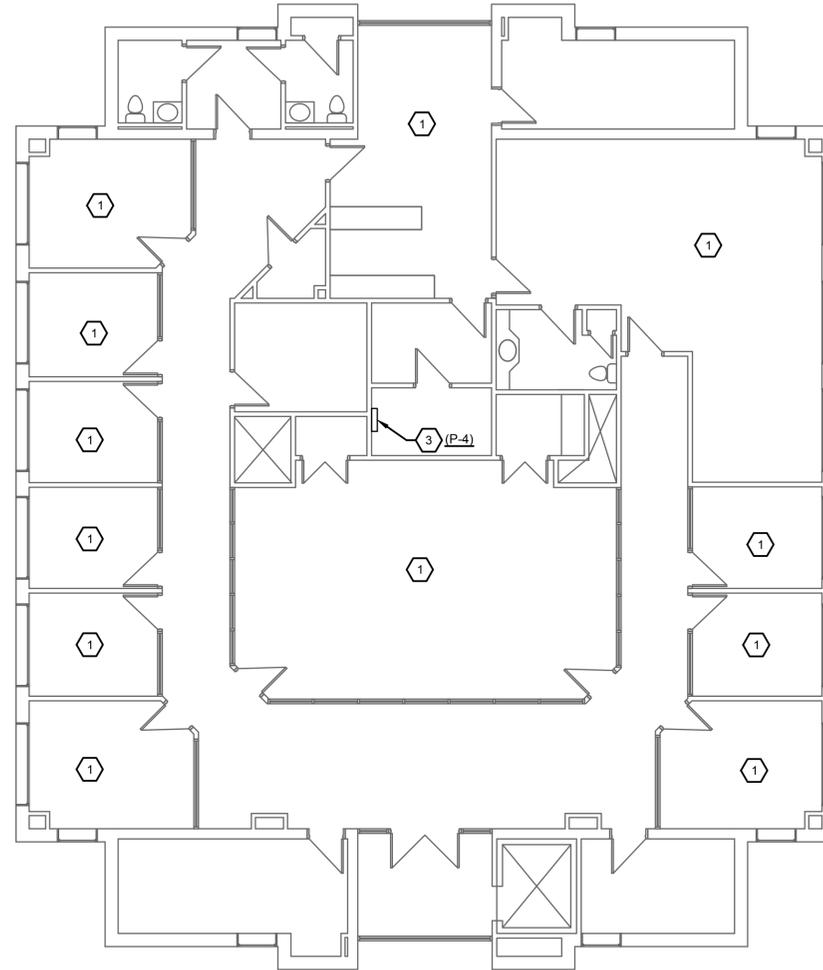

2 THIRD FLOOR POWER DEMO PLAN

0 2' 4' 8' 16'

NOTES (THIS SHEET)

1. SEE SHEET E-0.01 FOR SYMBOLS AND ABBREVIATIONS.
2. ALL EXISTING ELECTRICAL DEVICES AND LIGHTS TO REMAIN UNLESS OTHERWISE NOTED. NOT ALL EXISTING ELECTRICAL DEVICES AND LIGHTS SHOWN.
3. ALL EXISTING CEILING MOUNTED DEVICES IN CEILINGS BEING REMOVED FOR CONSTRUCTION ARE TO BE REMOVED AND/OR PROTECTED DURING CONSTRUCTION, AND REINSTALLED AFTER CONSTRUCTION IS COMPLETED, UNLESS OTHERWISE NOTED.

DEMOLITION KEYNOTES

1. DISCONNECT AND REMOVE EXISTING DUPLEX RECEPTACLE.
2. DISCONNECT AND REMOVE EXISTING QUADPLEX RECEPTACLE.

KEYNOTES (THIS SHEET)

1. EXISTING RECEPTACLES IN THIS AREA TO REMAIN.
2. EXISTING QUADPLEX RECEPTACLE TO REMAIN.
3. EXISTING POWER PANEL TO REMAIN.

PROJECT TITLE

**E07825001 ENVOY - FLOYD
COUNTY ANNEX
RENOVATION**

DESIGNED BY: ARW
DRAWN BY: ARW
CHECKED BY: NTP
DATE CHECKED: 05/16/25

07/03/25 ADDENDUM #1


DATE REVISION

DRAWING TITLE

**SECOND & THIRD FLOOR
POWER DEMO PLAN**


PROJECT No.
E07825001

DRAWING No.
E-1.11

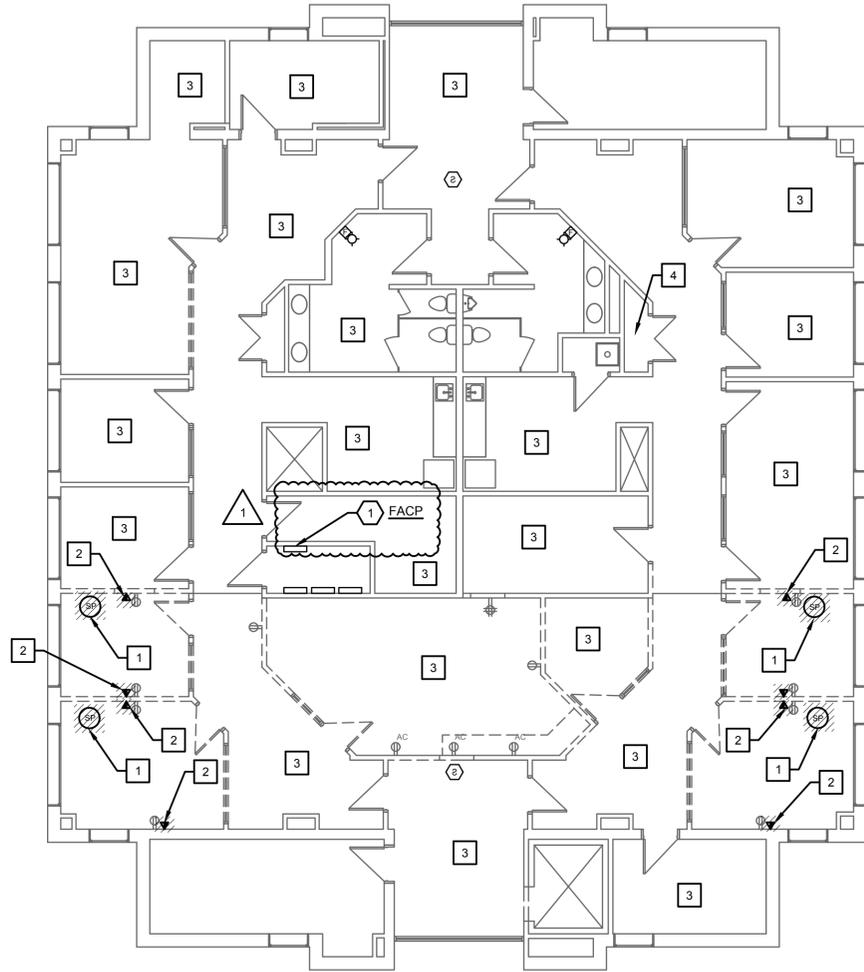

1 SECOND FLOOR SYSTEM DEMO PLAN

0 2' 4' 8' 16'

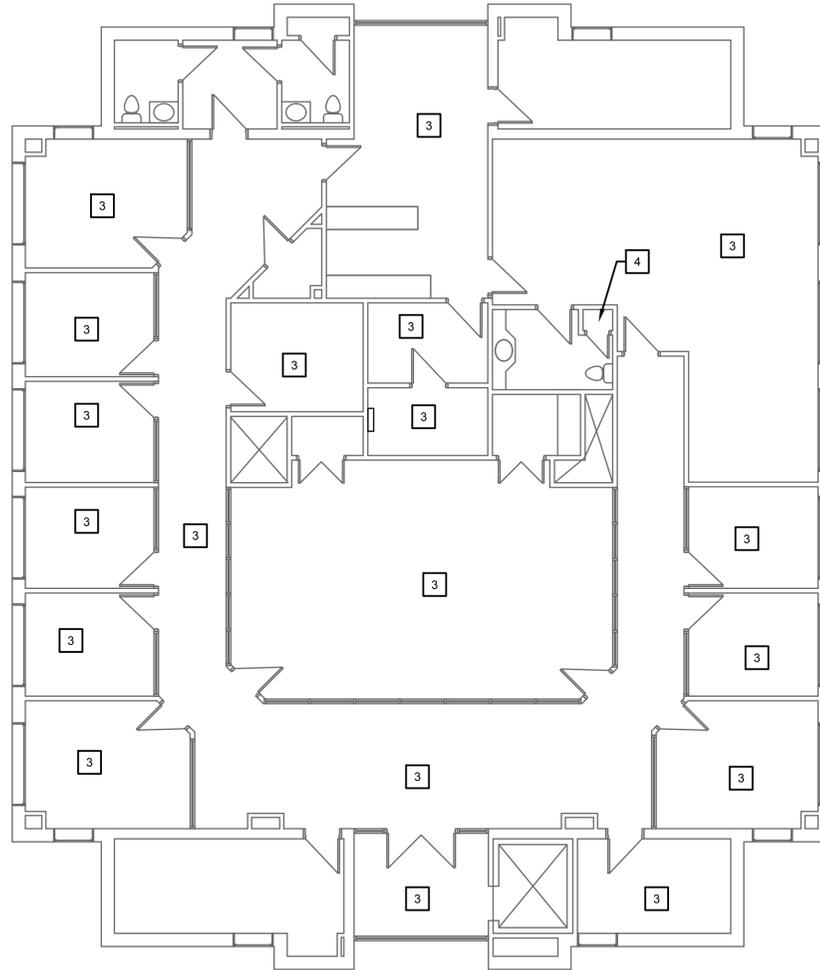

2 THIRD FLOOR SYSTEM DEMO PLAN

0 2' 4' 8' 16'



NOTES (THIS SHEET)

1. SEE SHEET E-0.01 FOR SYMBOLS AND ABBREVIATIONS.
2. ALL EXISTING ELECTRICAL DEVICES AND LIGHTS TO REMAIN UNLESS OTHERWISE NOTED. NOT ALL EXISTING ELECTRICAL DEVICES AND LIGHTS SHOWN.
3. ALL EXISTING CEILING MOUNTED DEVICES IN CEILINGS BEING REMOVED FOR CONSTRUCTION ARE TO BE REMOVED AND/OR PROTECTED DURING CONSTRUCTION, AND REINSTALLED AFTER CONSTRUCTION IS COMPLETED, UNLESS OTHERWISE NOTED.
4. CONTRACTOR SHALL REMOVE ALL EXISTING ACCESS CONTROL DEVICES, CABLING AND SUPPORTING HARDWARE BACK TO SOURCE.
5. CONTRACTOR SHALL REMOVE ALL EXISTING VIDEO SURVEILLANCE DEVICES AND CABLING BACK TO SOURCE.
6. ALL EXISTING COMMUNICATIONS CABLING WILL BE REPLACED. CONTRACTOR SHALL REMOVE ALL EXISTING DEVICES, WALL PLATE AND CABLING BACK TO SOURCE. EXISTING SUPPORTING HARDWARE SHALL BE PERMITTED TO BE REUSED IF IT IS GOOD CONDITIONS AND MEETS THE REQUIREMENTS OF THE SPECIFICATIONS.

DEMOLITION KEYNOTES

1. DISCONNECT AND REMOVE EXISTING ABANDONED CEILING MOUNTED SPEAKER.
2. DISCONNECT AND REMOVE EXISTING DATA DEVICE. REMOVE WIRING BACK TO PATCH PANEL IN EXISTING DATA CLOSET.
3. DISCONNECT AND REMOVE EXISTING DATA DEVICES IN THIS AREA. REMOVE WIRING BACK TO PATCH PANEL IN EXISTING DATA CLOSET.
4. EXISTING DATA CLOSET. REMOVE EXISTING PATCH PANELS. PROTECT EXISTING RACKS FOR REUSE.

KEYNOTES (THIS SHEET)

1. EXISTING FIRE ALARM CONTROL PANEL.

PROJECT TITLE

**E07825001 ENVOY - FLOYD
 COUNTY ANNEX
 RENOVATION**

DESIGNED BY: ARW
 DRAWN BY: ARW
 CHECKED BY: NTP
 DATE CHECKED: 05/16/25

07/03/25 ADDENDUM #1

DATE REVISION

DRAWING TITLE

**SECOND & THIRD FLOOR
 SYSTEM DEMO PLAN**

PROJECT No.
E07825001

DRAWING No.
E-1.21

LUMINAIRE SCHEDULE

LUMINAIRE			LAMP			BALLASTS/DRIVER			MOUNT	DESCRIPTION	NOTES
TYPE	MANUFACTURER	CATALOG NUMBER	DESCRIPTION	NO.	WATTS	TYPE	NO.	VOLTAGE			
EM	LITHONIA	ECRG H0 SQ M6	LED	2	4	NA	NA	120	CEILING	COMBO EXIT AND EMERGENCY	1

SCHEDULE NOTES:
 1. SCHEDULE CONTAINS THE PREAPPROVED FIXTURES FOR THIS PROJECT. ANY SUBSTITUTIONS MUST BE APPROVED PRIOR TO THE BID DATE BY THE ENGINEER.

PANEL:	P-5	OC DEVICE TYPE:	CB	ENCLOSURE:	SURFACE	BUS RATING (A):	100
LOCATION:	3RD FLOOR	DEVICE FAMILY:	BOLT-ON	MOUNTING:		WITHSTAND (A):	10,000
FED FROM:	P-4	MAIN BREAKER:	M.L.O.	L-L	L-N		
		WIRING:	4W+G	VOLTAGE:	208 120		

CCT	P	AMPS	LOAD DESCRIPTION	NOTES	LOAD (VA)	A _φ (VA)	B _φ (VA)	C _φ (VA)	LOAD (VA)	DESCRIPTION	NOTES	AMPS	P	CCT		
1	1	20	2ND FLOOR RECEPTACLES	-	360	1560			1200	3RD FLOOR MAG LOCKS	-	20	1	2		
3	1	20	2ND FLOOR RECEPTACLES	-	360		1560		1200	3RD FLOOR MAG LOCKS	-	20	1	4		
5	1	20	2ND FLOOR RECEPTACLES	-	360			1560	1200	3RD FLOOR MAG LOCKS	-	20	1	6		
7	1	20	2ND FLOOR RECEPTACLES	-	360	360			0	SPARE	-	20	1	8		
9	1	20	2ND FLOOR RECEPTACLES	-	360		360		0	SPARE	-	20	1	10		
11	1	20	2ND FLOOR COUNTER RECEPTS	-	720			720	0	SPARE	-	20	1	12		
13	1	20	2ND FLOOR PRINTER	-	960	960			0	SPARE	-	20	1	14		
15	1	20	2ND FLOOR PRINTER	-	960		960		0	SPARE	-	20	1	16		
17	1	20	2ND FLOOR COPIER	-	1200			1200	0	SPARE	-	20	1	18		
19	1	20	2ND FLOOR MAG LOCKS	-	1200	1200			0	SPARE	-	20	1	20		
21	1	20	2ND FLOOR MAG LOCKS	-	1200		1200		0	SPARE	-	20	1	22		
23	1	20	2ND FLOOR MAG LOCKS	-	1200			1200	0	SPARE	-	20	1	24		
25	1	20	2ND FLOOR SF-1	-	264	264			0	SPARE	-	20	1	26		
27	1	20	3RD FLOOR SF-2	-	264		264		0	SPARE	-	20	1	28		
29	1	20	SPARE	-	0			0	0	SPARE	-	20	1	30		
31	1	20	SPARE	-	0	0			0	SPARE	-	20	1	32		
33	1	20	SPARE	-	0		0		0	SPARE	-	20	1	34		
35	1	20	SPARE	-	0			0	0	SPARE	-	20	1	36		
37	1	20	SPARE	-	0	0			0	SPARE	-	20	1	38		
39	1	20	SPARE	-	0		0		0	SPARE	-	20	1	40		
41	1	20	SPARE	-	0			0	0	SPARE	-	20	1	42		
TOTAL VA PER PHASE:					4,344	4,344	4,680	TOTAL VA THIS PANEL:					13,368			
TOTAL AMPS PER PHASE:					36	36	39									

KEYNOTES (THIS SHEET)

- PROVIDE NEW 100A/3P BREAKER AT EXISTING PANEL P-4. PANEL P-4 UTILIZES SQUARE D TYPE QO BREAKERS.
- PROVIDE PANEL P-5. SEE CIRCUIT DIRECTORY.
- PROVIDE (4) #2 AWG PHASE CONDUCTORS AND (1) #8 AWG EQUIPMENT GROUNDING CONDUCTOR IN 1-1/2" CONDUIT.


PROJECT TITLE
E07825001 ENVOY - FLOYD COUNTY ANNEX RENNOVATION

DATE REVISION

DRAWING TITLE
ELECTRICAL SCHEDULES & ONE-LINE DIAGRAM

PROJECT No.
E07825001

DRAWING No.
E-4.01

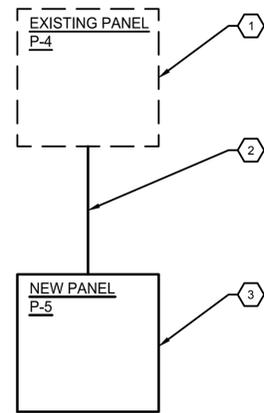


1 ONE-LINE DIAGRAM
 NOT TO SCALE


FIRE PROTECTION GENERAL NOTES

1. THE CONTRACTOR SHALL PROVIDE THE COMPLETE DESIGN AND DESIGN DRAWINGS FOR THE INSTALLATION OF THE FIRE SUPPRESSION SYSTEMS IN ACCORDANCE WITH NFPA STANDARDS. THESE DRAWINGS SHALL BE PREPARED AND SIGNED BY A PROFESSIONAL ENGINEER LICENSED IN THE STATE OF ILLINOIS.
 - A. THE DESIGN OF THE FIRE SUPPRESSION SYSTEM SHALL BE IN ACCORDANCE WITH THE FOLLOWING CODES:
 - a. IBC - 2021 EDITION
 - b. NFPA 13 - 2022 EDITION
 - B. EXCEPT WHERE NOTED ON THE DRAWINGS, ALL AREAS SHALL BE COMPLETELY PROTECTED BY AN APPROVED AUTOMATIC WET FIRE SUPPRESSION SYSTEM.
 - a. THE SYSTEM SHALL BE DESIGNED TO ACCOMMODATE THE HAZARD LEVEL AS SHOWN ON THE DRAWINGS.
 - b. NO MODIFICATION IS BEING MADE TO THE EXISTING FIRE DEPARTMENT CONNECTION.
 - C. THE CONTRACTOR SHALL PROVIDE ALL DRAWINGS, CALCULATIONS, AND ADDITIONAL DOCUMENTATION TO ENGINEER.
2. CONTRACTOR SHALL VERIFY LOCATION OF ALL EXISTING SPRINKLER HEADS AND PIPING, AND THAT ALL EXISTING PIPING IS ADEQUATELY SIZED FOR REVISED LAYOUT. CONTRACTOR SHALL INCLUDE COST ASSOCIATED WITH UP SIZING THE MAIN IN AREAS WHERE PIPING IS NOT ADEQUATELY SIZED.
3. ALL NEW SPRINKLER PIPING SHALL BE ROUTED TO CONSERVE BUILDING SPACE. ALL PIPING TO BE EXPOSED SHALL BE CLEARLY DISPLAYED AND LABELED ON CONTRACTOR SUPPLIED DRAWINGS. WHERE EXPOSED, ALL PIPING SHALL BE ROUTED IN BETWEEN OR ADJACENT TO THE STRUCTURE.
4. CONTRACTOR SHALL COORDINATE LOCATION AND ELEVATION OF NEW FIRE PROTECTION PIPING AND SYSTEM WITH EXISTING AND NEW RECESSED AND SURFACE MOUNTED LIGHTS, SMOKE DETECTORS, ALL EXISTING AND NEW CONDUITS, PIPING, DUCTWORK AND OTHER UTILITIES PRIOR TO INSTALLATION. WHERE CONDUITS, PIPING OR DUCTWORK REQUIRE RELOCATION TO INSTALL SPRINKLER PIPING, THE CONTRACTOR SHALL INCLUDE ALL COSTS ASSOCIATED WITH RELOCATING THE CONDUIT, PIPING OR DUCTWORK IN THEIR BID.
5. ALL CUTTING AND PATCHING AS REQUIRED TO INSTALL THE FIRE SUPPRESSION SYSTEM SHALL BE BY THE CONTRACTOR.
6. ALL EXPOSED FIRE PROTECTION PIPING SHALL BE PAINTED IN ACCORDANCE WITH THE SPECIFICATIONS. COLOR TO BE SELECTED BY THE ARCHITECT.
7. NO SPRINKLER PIPING AND/OR SPRINKLER HEADS SHALL BE LOCATED DIRECTLY ABOVE ELECTRICAL EQUIPMENT.
8. PIPING IS SHOWN IN SCHEMATIC FORM ONLY. CHANGES IN ELEVATION ARE NOT NECESSARILY SHOWN. ROUTE PIPING IN AN ORDERLY MANNER AS REQUIRED FOR CLEARANCE WITH STRUCTURAL CONDITIONS. COORDINATE LOCATION OF PIPING WITH OTHER TRADES PRIOR TO INSTALLATION. WHERE POSSIBLE, RACK PIPING HORIZONTALLY OR VERTICALLY.
9. ALL CONNECTIONS TO, OR SHUTDOWNS OF, EXISTING SYSTEMS SHALL BE COORDINATED WITH THE OWNER TO PROVIDE MINIMUM INTERFERENCE WITH THEIR OPERATION AND DOWNTIME OF THE SYSTEM.
10. CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ADEQUATE SUPPORTING SYSTEMS AND DEVICES FOR ALL PIPING, EQUIPMENT, AND ACCESSORIES PER NFPA REQUIREMENTS.
11. CONTRACTOR IS REQUIRED TO INSTALL DRAIN VALVES IF PIPING ELEVATIONS ARE CHANGED DUE TO EXISTING UTILITIES. COORDINATE LOCATION OF DRAIN VALVE WITH OWNER AND USER. LABEL ALL DRAIN VALVES. SHOW ALL DRAIN VALVES ON AS-BUILT DRAWINGS. LOCATE ALL VALVES IN ACCESSIBLE LOCATION.
12. PROVIDE AND INSTALL SLEEVES FOR ALL PIPING PASSING THROUGH WALLS.
13. PROVIDE FIRE STOPPING OR FIRE CAULK AT ALL PENETRATIONS OF FIRE AND/OR SMOKE RATED WALLS, CEILINGS, AND FLOORS. SEE ARCHITECTURAL DRAWINGS FOR LOCATIONS OF FIRE AND/OR SMOKE RATED WALLS, CEILINGS, AND FLOORS.


FIRE PROTECTION LEGEND

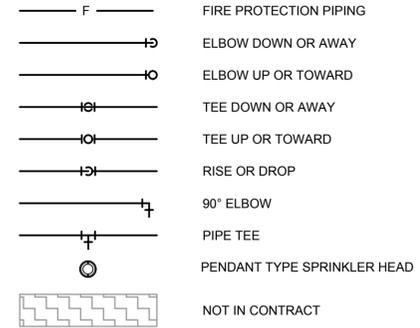


SPRINKLER HAZARD LEGEND

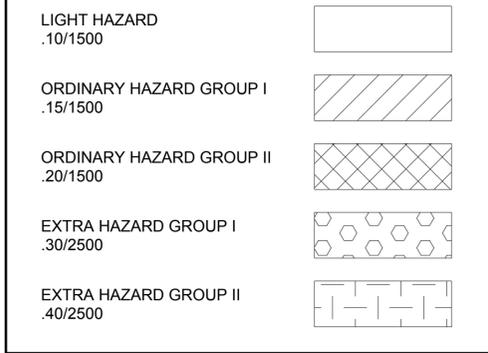

DATE	REVISION
07/03/25	ADDENDUM #1

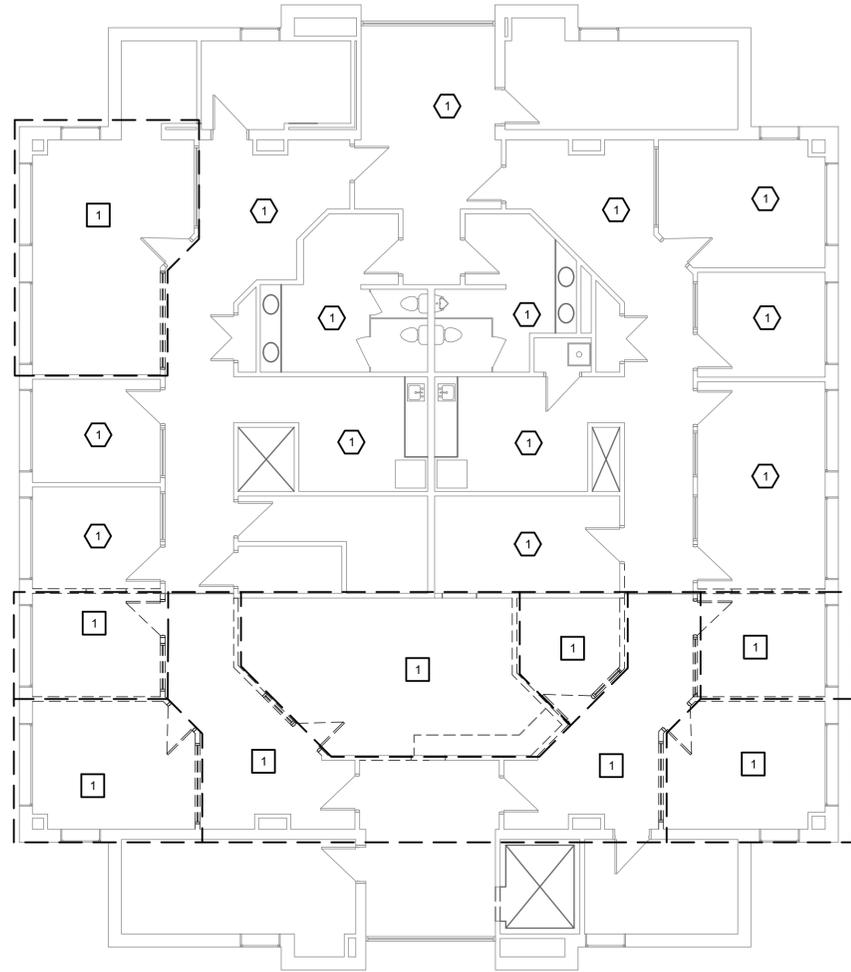

1 SECOND FLOOR FIRE PROTECTION DEMO PLAN

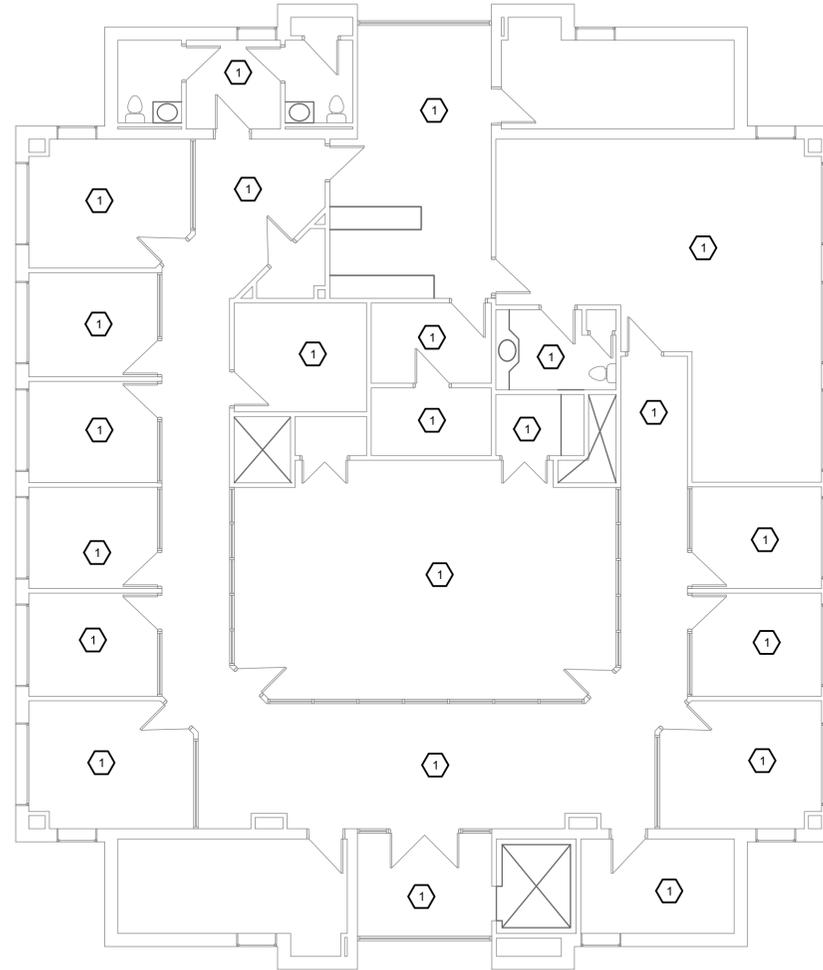

2 THIRD FLOOR FIRE PROTECTION DEMO PLAN



NOTES (THIS SHEET)

- 1. SEE SHEET FP-0.01 FOR SYMBOLS AND ABBREVIATIONS.

DEMOLITION KEYNOTES

- 1. REMOVE EXISTING SPRINKLER HEADS IN THIS AREA.

KEYNOTES (THIS SHEET)

- 1. EXISTING SPRINKLER HEADS AND PIPING IN THIS AREA TO REMAIN.

ClarkDietz

DESIGN FIRM REGISTRATION NO. 184-000450
 125 W. CHURCH STREET
 CHAMPAIGN, IL 61820
 PHONE : 217.373.8900 www.clarkdietz.com

PROJECT TITLE

**E07825001 ENVOY - FLOYD
 COUNTY ANNEX
 RENNOVATION**

DESIGNED BY: ARW
 DRAWN BY: ARW
 CHECKED BY: NTP
 DATE CHECKED: 05/16/25

07/03/25 ADDENDUM #1

DATE REVISION

DRAWING TITLE

**SECOND & THIRD FLOOR FIRE
 PROTECTION DEMO PLAN**


PROJECT No.

E07825001


DRAWING No.

FP-1.01

DWG OF DWGS

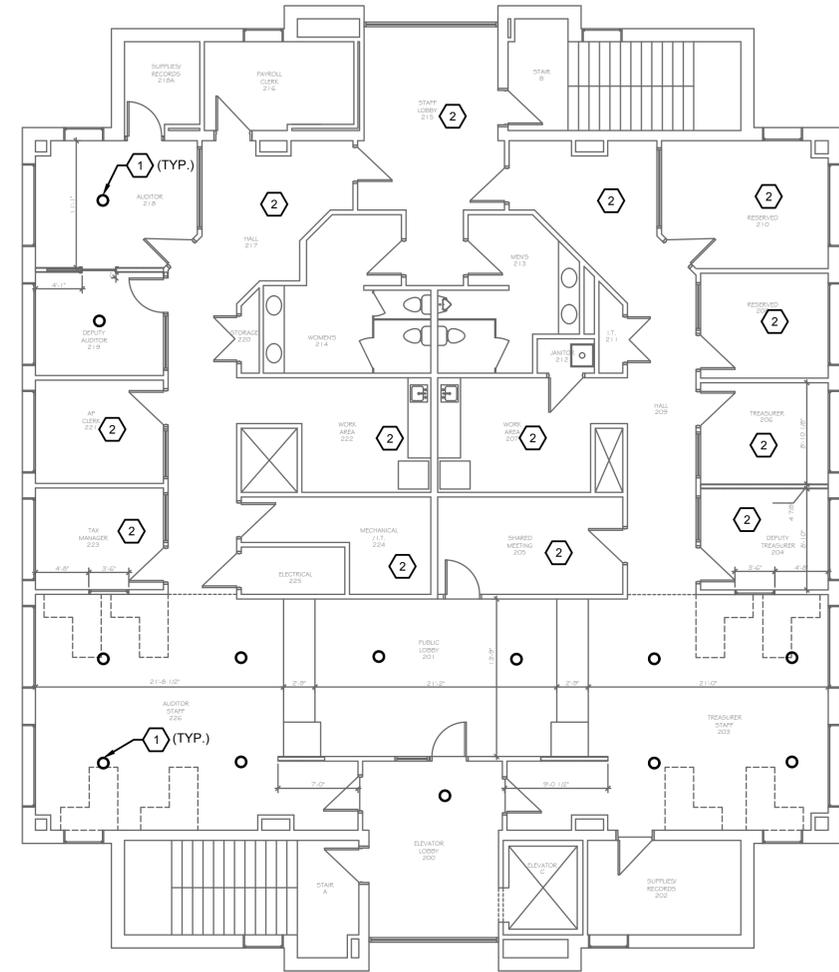

1 SECOND FLOOR FIRE PROTECTION NEW PLAN

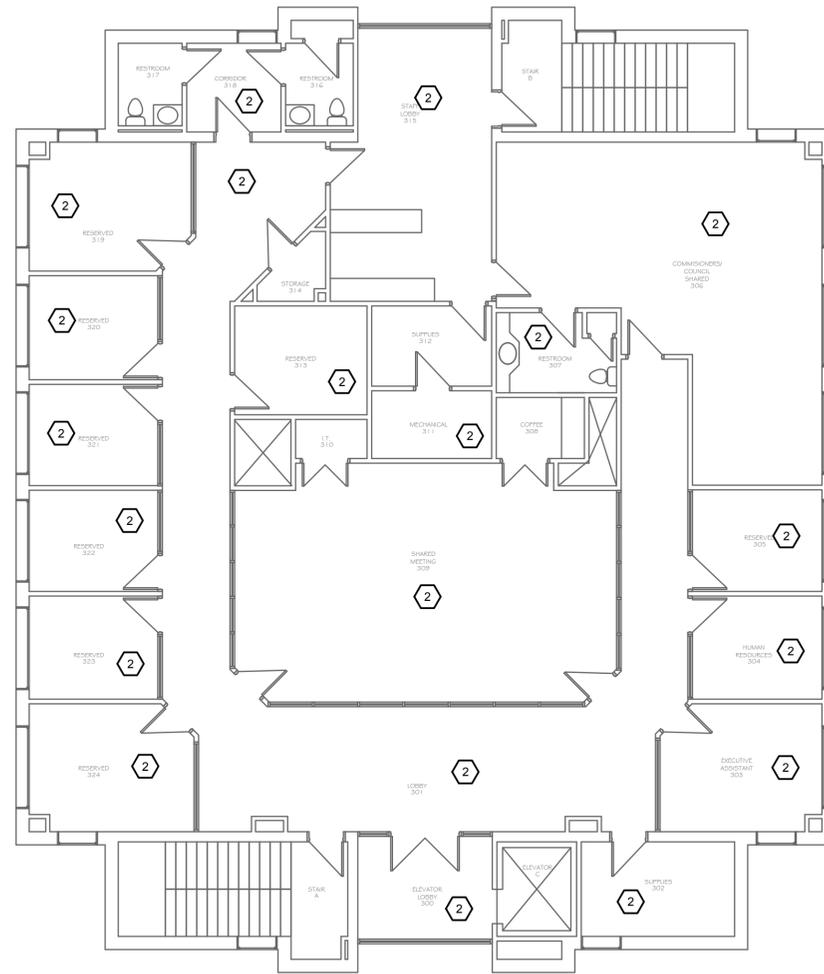

2 THIRD FLOOR FIRE PROTECTION NEW PLAN



NOTES (THIS SHEET)

- SEE SHEET FP-0.01 FOR SYMBOLS AND ABBREVIATIONS.

KEYNOTES (THIS SHEET)

- PROVIDE NEW SPRINKLER HEADS IN THIS AREA. REVISE SPRINKLER PIPING AS NEEDED TO ACCOMMODATE NEW SPRINKLER HEAD LOCATIONS IN NEW CEILING GRID. PROVIDE COVERAGE AS REQUIRED BY NFPA 13.
- EXISTING SPRINKLER HEADS AND PIPING IN THIS AREA TO REMAIN.

PROJECT TITLE
**E07825001 ENVOY - FLOYD
 COUNTY ANNEX
 RENOVATION**

DESIGNED BY: ARW
 DRAWN BY: ARW
 CHECKED BY: NTP
 DATE CHECKED: 05/16/25

07/03/25 ADDENDUM #1

DATE REVISION

DRAWING TITLE
**SECOND & THIRD FLOOR FIRE
 PROTECTION NEW PLAN**

PROJECT No.
E07825001

DRAWING No.
FP-2.01

DWG OF DWGS